



BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED
(Wholly owned Government of Karnataka Undertaking)

No: BESCOM/CGM (OP)/DGM (OP3)/2022-23/ 45-07
E-Mail Id: cgm.op.work@gmail.com

Corporate Office
K. R. Circle,
Bangalore - 560 001.
Date:

- 8 APR 2022

CIRCULAR

Sub: Simplification of procedures & fixing of timeline at each office for sanctioning of HT power supply to the prospective consumers & checklist to be ensured before submitting proposal of arranging power supply to corporate office - **regarding.**

Ref: Note approved by MD BESCOM for draft flow charts & checklist
Dated: 31.03.2022

Preamble:

This is to inform that, Corporate office is receiving complaints by the Industrial consumers/public, stating that the process of sanctioning of power supply to HT applications at various offices of BESCOM are taking undue delay, due to which the prospective consumers/applicants are failing to avail power supply at their required time. In this regard, MD, BESCOM directed to fix the timelines & procedures for processing the power supply applications at each office in the form of flow chart and also to prepare a checklist to be ensured before submitting the proposal of arranging power supply to corporate office.

Hence, this circular,

No.: BESCOM/CGM (OP)/DGM (OP3)/2022-23/ 45-07

- 8 APR 2022
Dated:

The flowcharts duly fixing the timeline & procedures, to be followed for processing the HT power supply applications at each C, O & M offices and a checklist to be ensured before submitting the proposal of arranging power supply to corporate office is herewith enclosed & same shall be followed while processing the power supply applications at each office.

Chief General Manager (Ele)
Operations BESCOM

Copy to, for information & needful action:


1. The Chief Engineer, Elec., (C, O&M), Zone, BMAZ (North)/ BMAZ (South)/BRAZ/CTAZ, BESCOM.
2. The General Manager (Ele.), ICT & MIS/Revenue, Corporate Office, BESCOM.
3. The Superintending Engineer (Ele.), East/West/North/South/BRC/ Ramanagar/Kolar/Tumkur/Davanagere Circle, BESCOM.
4. All the Executive Engineer (Ele.), C, O & M Divisions/MT Divisions, BESCOM.
5. All the Assistant Executive Engineer (Ele.), C, O&M Sub Division, BESCOM.
6. MF.


Copy to, for information:

The PS to MD/DT with a request to place the same before MD/DT, BESCOM.

Procedures in BESCOM For A/P/S to HT applications upto 500 kVA under self execution

Starting point for HT application registration	- EE, Division Office
Power sanctioning authority (as per BESCOM FDoP)	- EE, Division office
No. of Days fixed to arrange power supply in flow chart	- 40 days for within EE DoP /45 days for within SE & CEE DoP

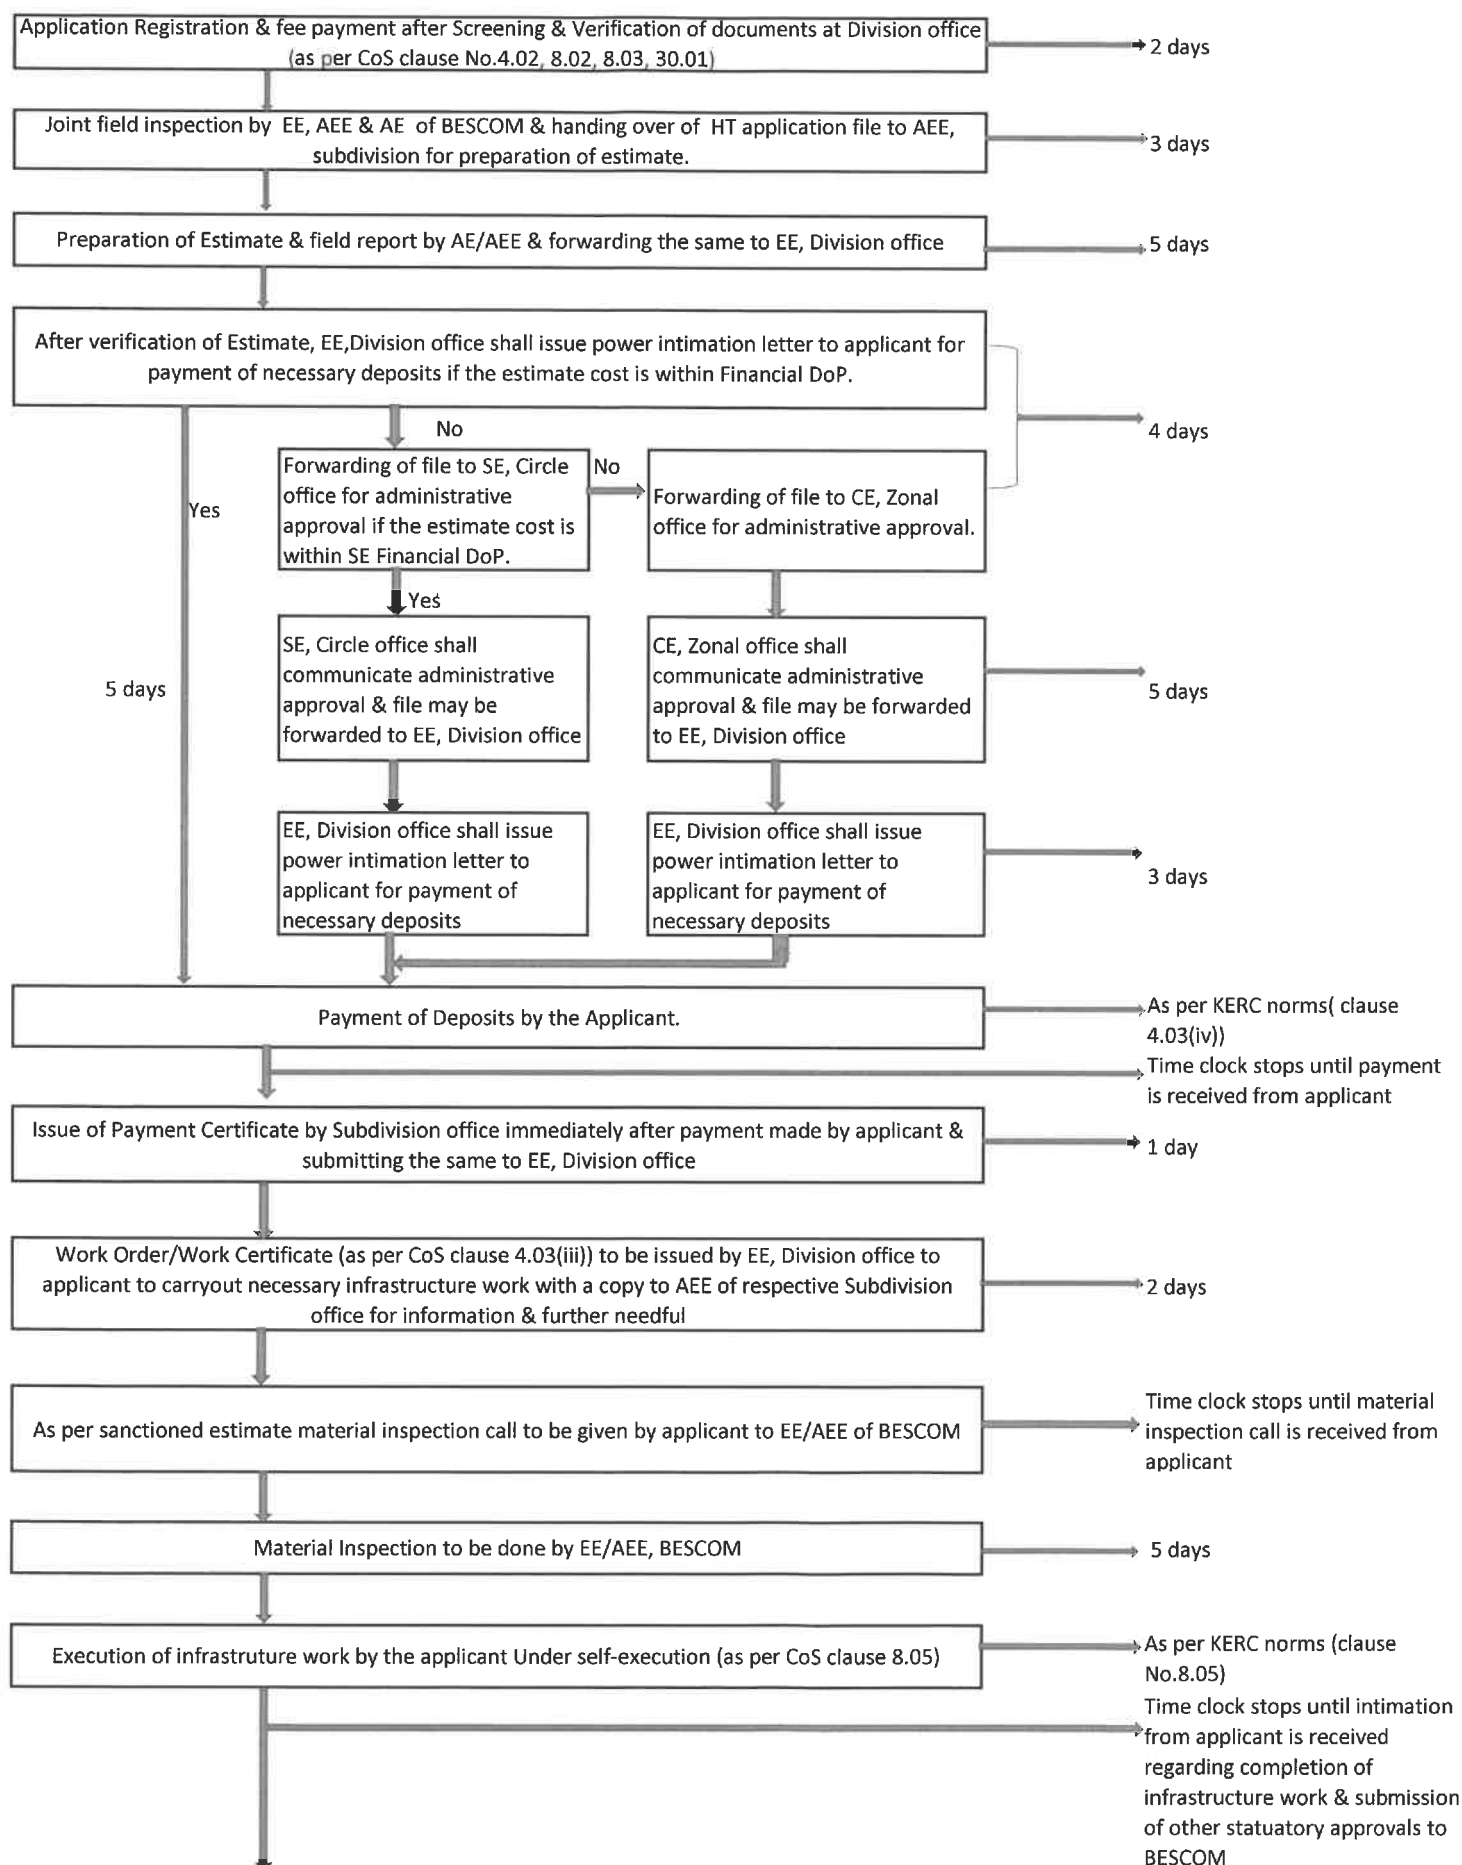

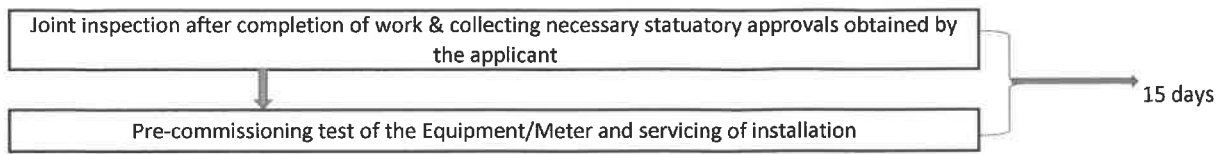

Note:
1.Electrical Infrastructure work required for regular source & alternate source shall be completed before service.

Procedures in BESCO For A/P/S to HT applications more than 500kVA less than 1000 kVA under self execution

Starting point for HT application registration


Power sanctioning authority (as per BESCO FDoP)


No. of Days fixed to arrange power supply in flow chart

EE, Division Office

SE, Circle office

40 days for within SE DoP /45 days for within CEE DoP

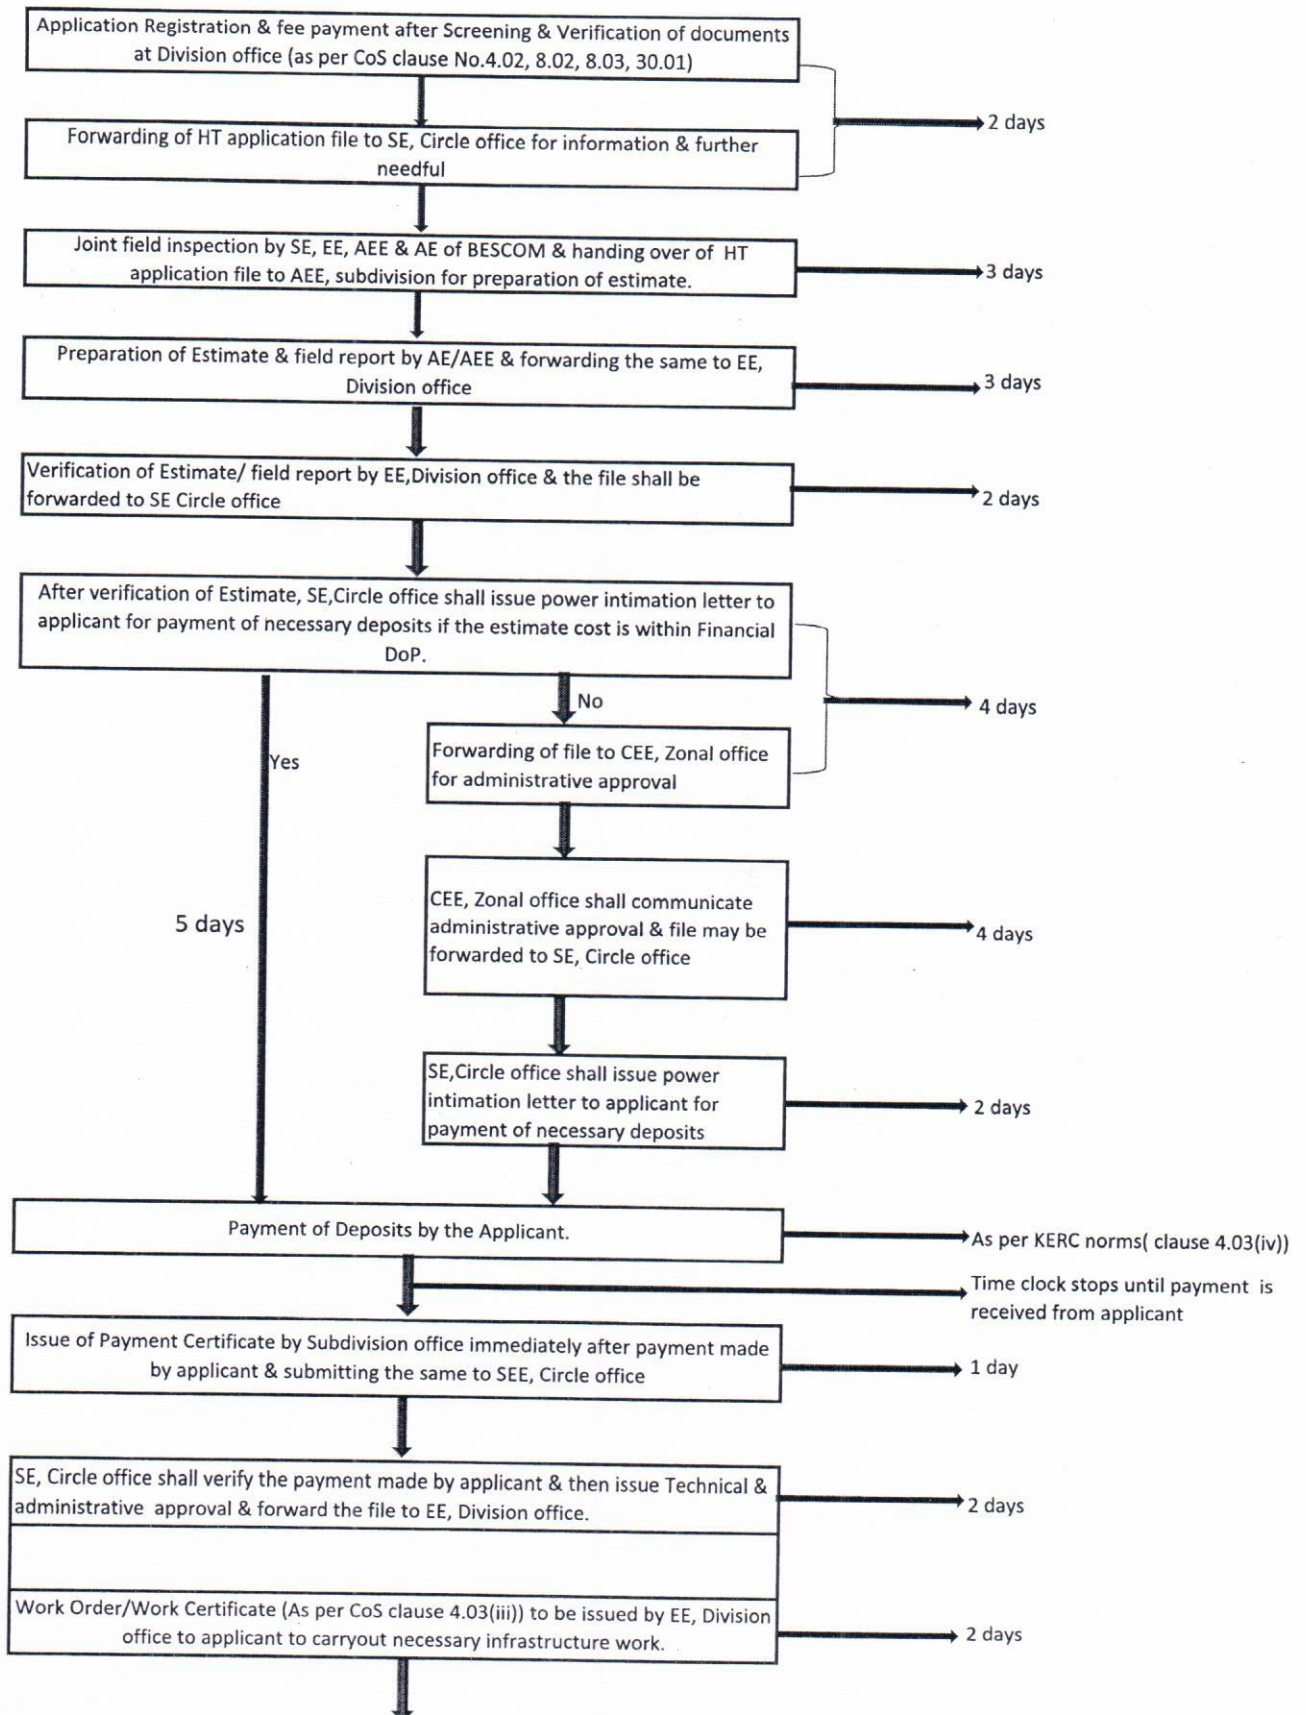


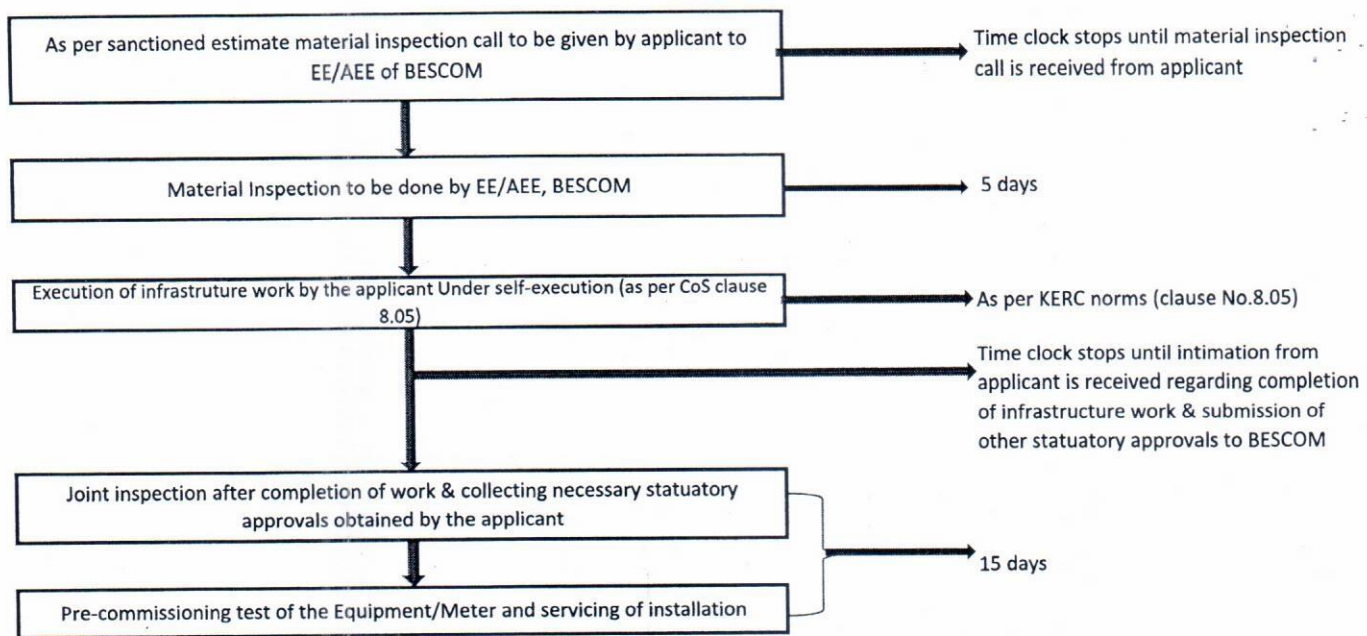


Note:1. Electrical Infrastructure work required for regular source & alternate source shall be completed before service.
2. Partial service shall not be given before completion of work.

Procedures in BESCOM For A/P/S to HT applications more than 1000kVA less than 2000 kVA under self execution

Starting point for HT application registration	-	EE, Division Office
Power sanctioning authority (as per BESCOM FDoP)	-	CE, Zonal office
No. of Days fixed to arrange power supply in flow chart	-	45 days (as per DoP)

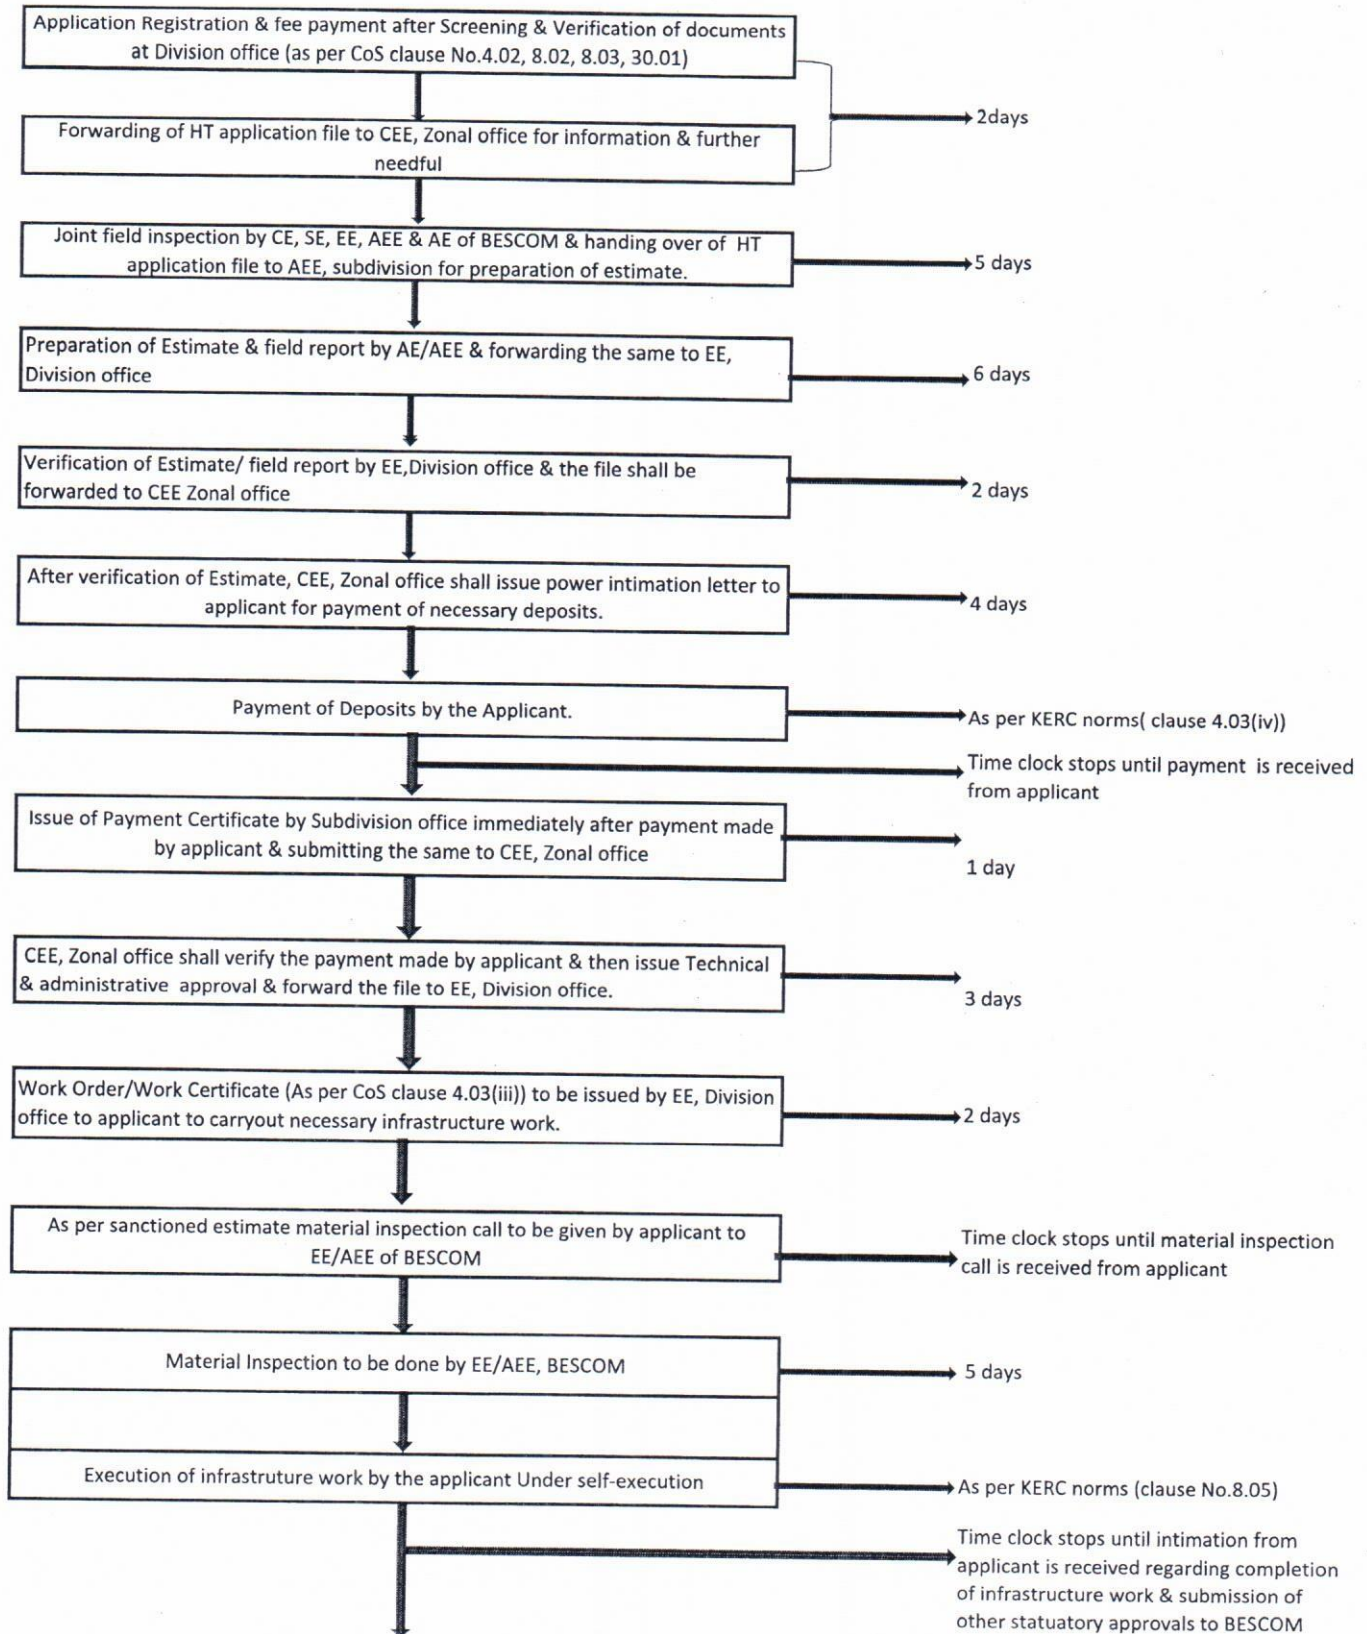

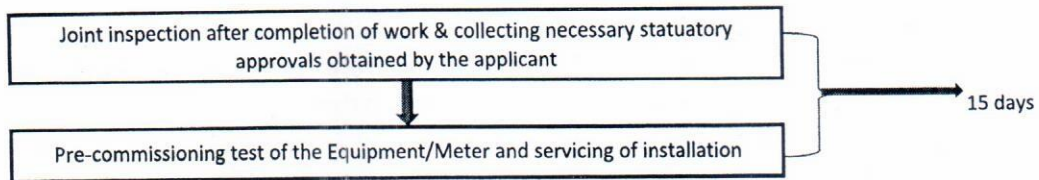

Note:1. Electrical Infrastructure work required for regular source & alternate source shall be completed before service.
2.No partial service shall be given before completion of work.

Procedures in BESCO For A/P/S to HT/EHT applications more than 2000kVA less than 7500 kVA under self execution

Starting point for HT application registration


Power sanctioning authority (as per BESCO FDoP)


No. of Days fixed to arrange power supply in flow chart

EE, Division Office

Corporate Office

50 days

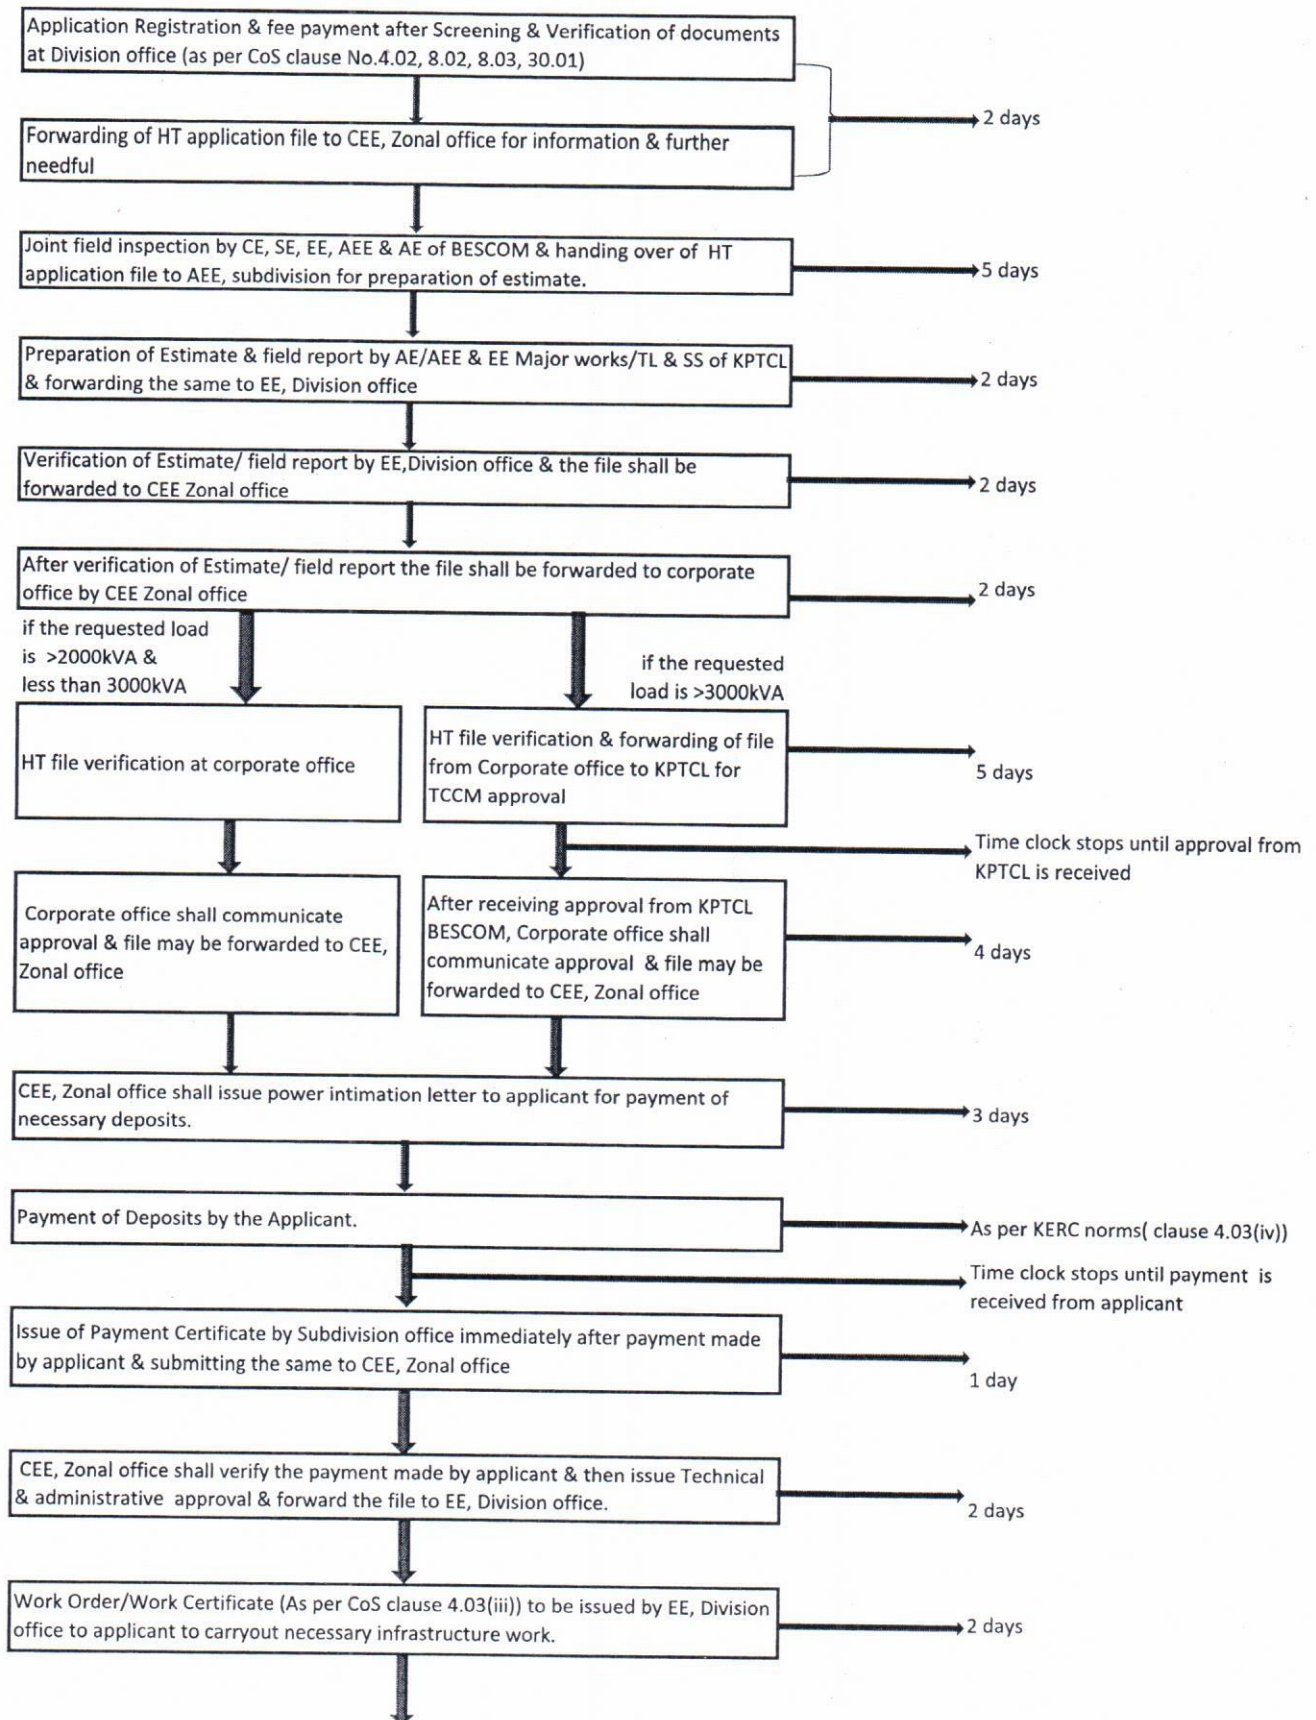

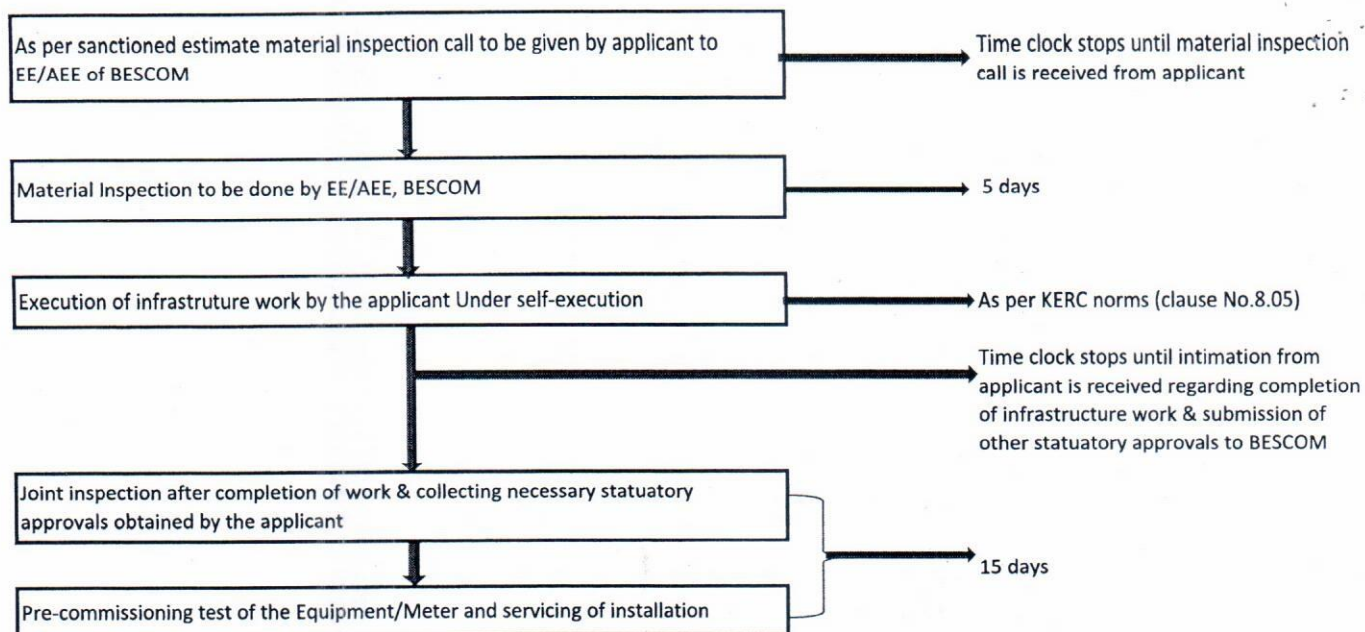

Note:1. Electrical Infrastructure work required for regular source & alternate source shall be completed before service.
2. No partial service shall be given before completion of work.


Procedures in BESCOM For A/P/S to HT/EHT applications more than 7500kVA under self execution


Starting point for HT application registration

Power sanctioning authority
(as per BESCOM FDoP)

No. of Days fixed to arrange power supply in flow chart

- EE, Division Office
- Corporate Office, BESCOM/ KPTCL
- 90 days

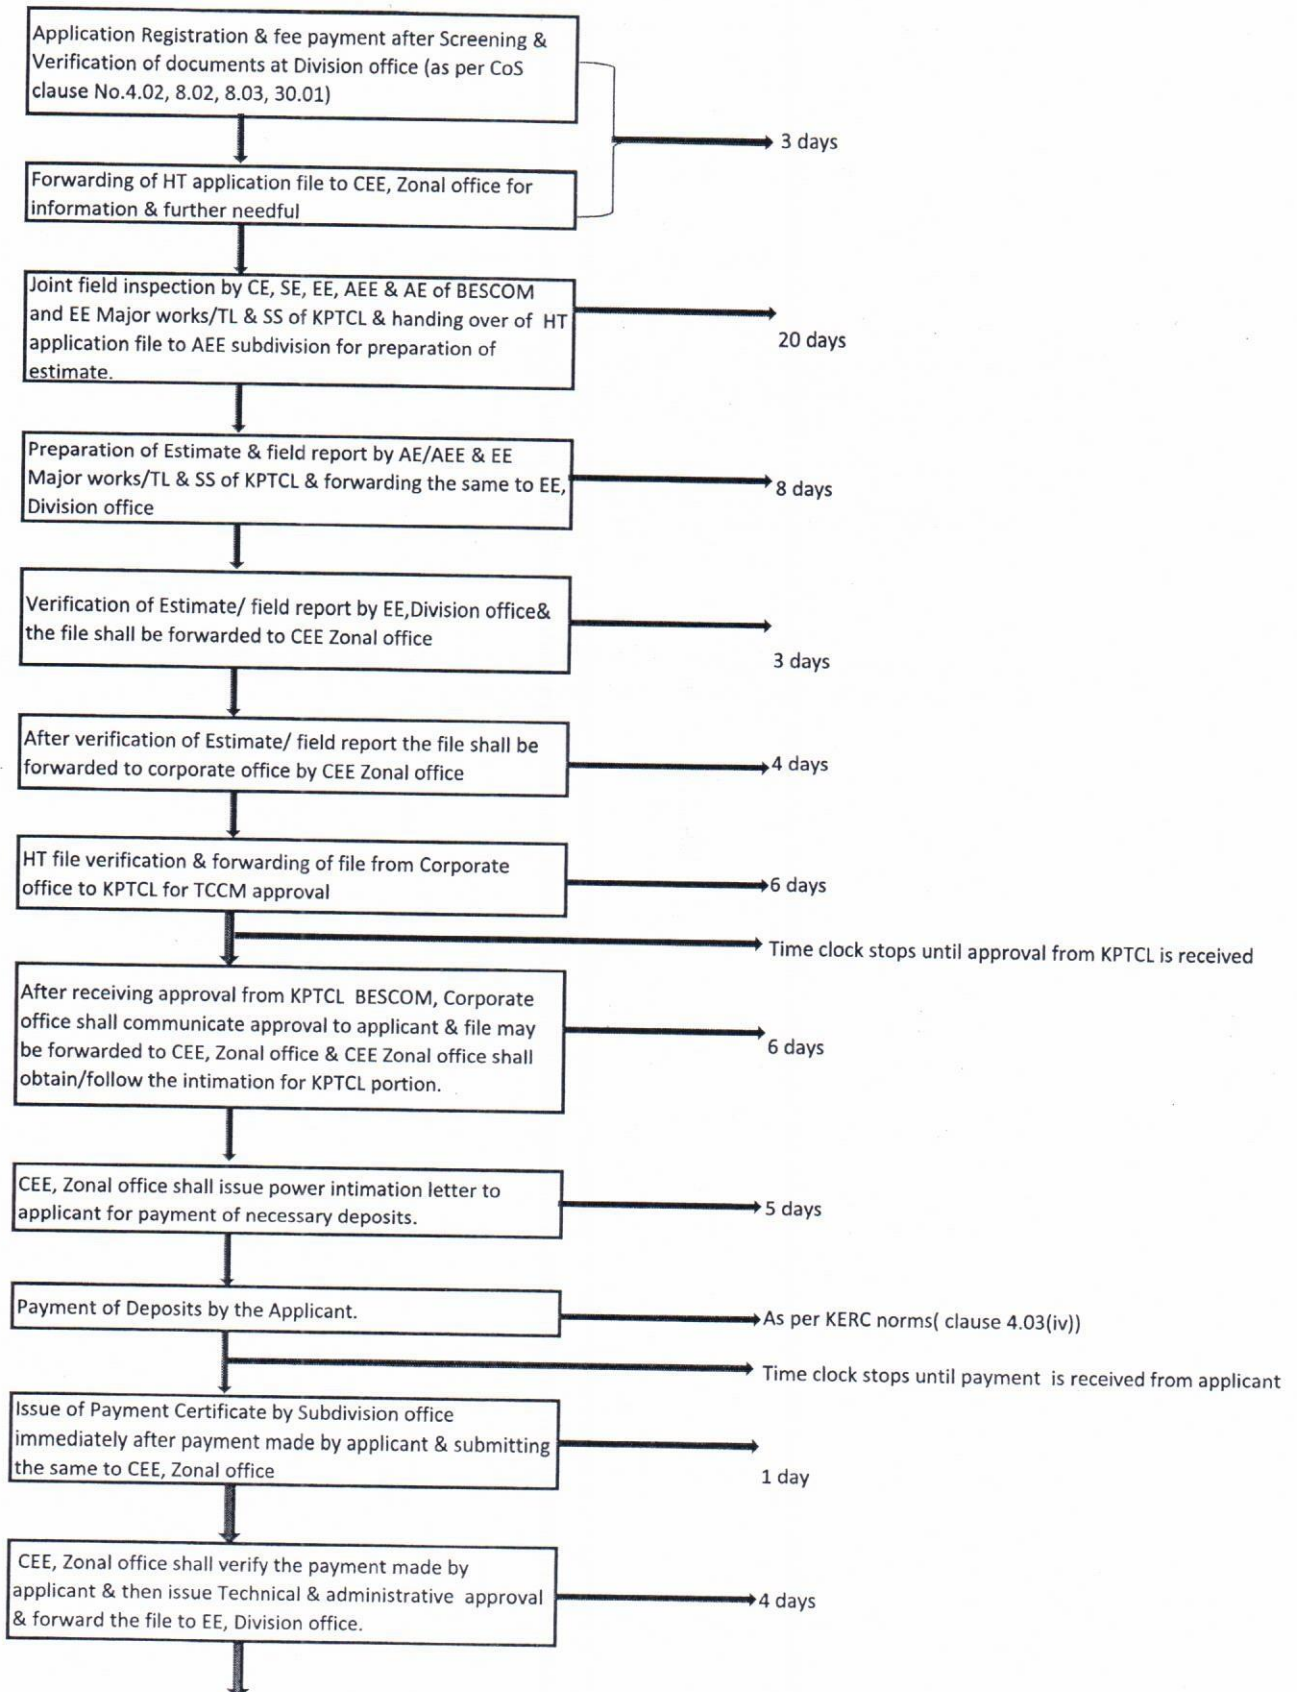

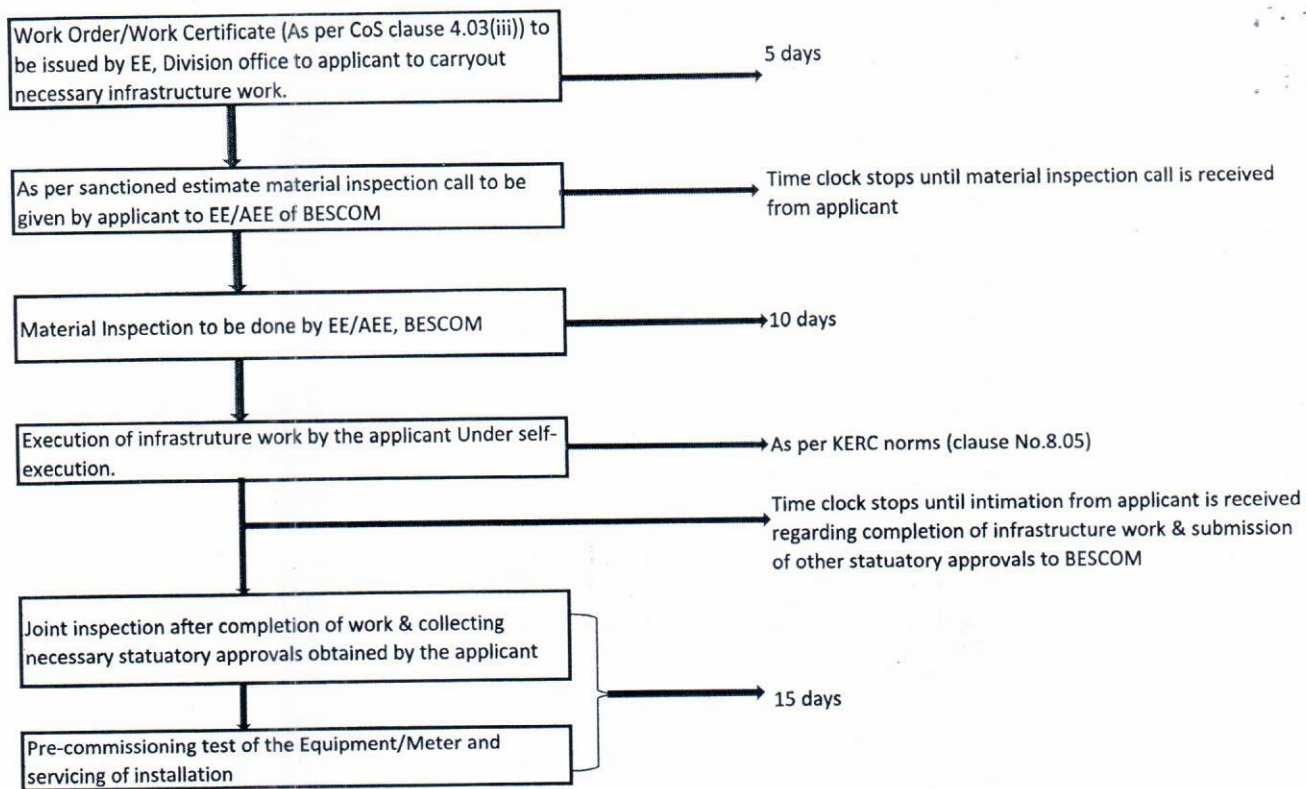

- Note:1. Electrical Infrastructure work required for regular source & alternate source shall be completed before service.**
2. No partial service shall be given before completion of work.