


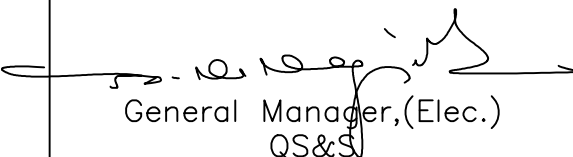


NOTES:-

1. THE PLATE SHALL BE MADE FROM MILD STEEL OF MINIMUM THICKNESS 1.6mm.
2. THE PLATE SHALL BE VITREOUS ENAMELLED WHITE WITH LETTERS, FIGURES AND THE CONVENTIONAL SKULL AND BONES IN SIGNAL RED COLOUR.
3. ALL LETTERING SHOULD BE CENTRALLY SPACED.
4. THE CORNERS OF THE PLATE SHOULD BE ROUNDED OFF.
5. THE REAR SIDE OF THE BOARD SHALL ALSO BE ENAMELLED.

	Signatures	All dimensions are in mm unless otherwise stated.	 BESCOM
Chd	 AGM (QS&S)	DETAILS OF DANGER BOARD FOR 11KV INSTALLATIONS	Approved:
Sub	 DGM (QS&S)		 General Manager, (Elec.) QS&S
SCALE: N.T.S			DRG.NO.BESCOM/GM/QS&S/40 REV-002 DATED:24-11-2018