



**BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED**  
(Wholly owned by Government of Karnataka Undertaking)

Telephone No. 080-22252128,

E-Mail [gmqs.work@gmail.com](mailto:gmqs.work@gmail.com), [gmqs@bescom.co.in](mailto:gmqs@bescom.co.in)

No: BESCOM/GM(QS&S)/AE/BC-11/21-22/

Encl:

O/o GM (QS&S)

Corporate Office,

K.R. Circle, Bangalore-1

Date: 09 MAR 2022

**OFFICIAL MEMORANDUM FOR VENDOR APPROVAL**

Sub :	Renewal of Vendor approval for supply of 8&9Mtr PSCC Poles-200kg WL, 9Mtr PSCC Poles-300kg WL, 8Mtr RCC pole -115kg WL & 9Mtr RCC pole-145kg WL to M/s Kalleshwara Concrete Products, Davangere.
Ref :	1. CEA Guidelines for validity of type test reports vide OM No: GM(QS&S)/DGM(EI)-3/BC-11/20-21/CYS-141 dtd:15.10.2020. 2. Firm Letter No: NIL dated: 30.12.2021. 3. Approved by Director (Technical) vide para (13)/2889 dtd: 09.03.2022 of T.O Note No: BESCOM/GM (QS&S)/AE/BC-11/21-22/2497 dtd: 08.03.2022.

\*\*\*\*\*

Approval is hereby accorded to the below mention firm as approved vendor to BESCOM for supply of the following materials to prospective consumers in BESCOM area for Electrification of layouts, M.S. Buildings, Action plan works, Self-execution works, Turnkey works & Partial Turnkey works etc.

Sl. No	Name of the Firm/ Address/Contact details	Equipment/Materials	Period of validity upto
1	M/s Kalleshwara Concrete Products, No.99, Avargere Igoor Road, Igoor Village, Igoor Post, Davangere Taluk Davangere Mobile: 9620426141 E-mail:mellakategroup@gmail.com	8Mtr PSCC pole -200kg WL	<b>28.01.2027</b> (Subject to revalidation once in 2 years)
2		9Mtr PSCC pole – 200kg WL	
3		9Mtr PSCC Poles-300kg WL	
4		8Mtr RCC pole – 115kg WL	
5		9Mtr RCC pole – 145kg WL	

**The approval is subject to the following conditions:-**

1. The prospective consumers who purchase above said material shall stand guarantee for the materials for a period of Five years from the date of commissioning.
2. The vendor shall furnish all the relevant valid type test reports (as per BESCOM Technical specification & its amendment from time to time) issued by M/s CPRI/ERDA or any Govt. lab/Testing houses only and Vendor approvals are considered based on type test reports as per circular cited reference (1).
3. All the components utilized for manufacturing above products has to be same as that of utilized in the type test sample.

4. The above materials shall be manufactured as per approved drawings (Please refer [www.bescom.karnataka.gov.in](http://www.bescom.karnataka.gov.in) for BESCO approved drawings) and GTP & drawing approvals shall be obtained before suppliers are made.
5. GTP and Drawing approvals shall be obtained by the firm before offering for inspections.
6. The above materials shall be got inspected by QS&S or the concerned jurisdictional Engineers, BESCO before they are put into service.
7. BESCO reserves the right to call for any document/credentials for verification during drawing approvals/inspection of material/equipment by BESCO authorities to ascertain the manufacturing experience/performance/technical suitability of the material. Further BESCO reserves the right to withdraw/cancel the vendor approval issued, in case of any violation of the approved drawing and specification at any time, poor quality /defective materials/equipment to BESCO projects, poor performance, poor after sales service, etc.
8. For renewal of vendor approval proposal shall be submitted one month prior to expiry of validity of vendor approval.

Approved by Director (Technical)

  
(T. S. Chandran)  
General Manager (El.,)  
Quality Standards and Safety,  
BESCO.

**Copy for information to:**

1. The Chief General Manager, Operations/CA/Projects, BESCO, Bangalore
2. All the Chief Engineer (Electy.,) O&M Zones, BESCO.
3. The General Manager (El.,) Procurement / DAS, BESCO.
4. All Superintending Engineers (El.,), O&M Circle, BESCO.
5. All Executive Engineers (Ele.) O&M Divisions, BESCO.
6. PS to D (T) to place it before Director (Technical), BESCO.
7. M/s Kalleshwara Concrete Products, No.99, Avargere Igoor Road, Igoor Village, Igoor Po, Davangere Taluk Davangere Mobile: 9620426141 E-mail:mellakategroup@gmail.com
8. Office copy / M.F.



**BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED**  
(Wholly owned by Government of Karnataka Undertaking)

Telephone No. 080-22252128

E-Mail [gmqs.work@gmail.com](mailto:gmqs.work@gmail.com), [gmqs@bescom.co.in](mailto:gmqs@bescom.co.in)

No: BESCOM/GM(Q,S&S)/AE/BC-11/21-22/CYS-171

Encl:

O/o GM(QS&S)

Corporate Office, K.R. Circle  
Bangalore-560 001

Date: 09 MAR 2022

**OFFICIAL MEMORANDUM FOR VENDOR APPROVAL**

Sub :	Vendor approval for supply of LT/HT Line Hardware Materials & Structural Materials by M/s Sri Ranganatha Agencies, Tumkur District.
Ref :	1. Firms letter No: NIL dated: 24.09.2021. 2. Approved by Director (Technical), BESCOM vide para (17)/2888 dated: 09.03.2022 of T.O note no: GM(QS&S)/DGM-3/BC-11/21-22/2355 dated: 22.02.2022.

\*\*\*\*\*

Approval is hereby accorded to the below mention firm as approved vendor to BESCOM for supply of the following material to prospective consumers in BESCOM area for Electrification of layouts, M.S. Buildings, Action plan works, Self-execution works, Turnkey works & Partial Turnkey works etc.

Sl. No	Name of the Firm/ Address/Contact details	Equipment/Materials	Period of validity upto
1	M/s Sri Ranganatha Agencies, Sy No:19/5, Ward No.2, Mavinakatte Post, Kunigal Taluk, Tumkur Dist - 572130 Ph No: 9845896950/9886033267	11kV Horizontal cross arm	09.03.2023
2		11kV Special 3 Pin Cross Arms	
3		2 Pin & 4 Pin cross Arm	
4		LT & HT Single top support	
5		Spiral Earth Electrode	
6		PG clamps	
7		Double Pole TC sets for erection of transformers of 25/63/100kVA & 100/300kVA on RCC/PSCC 9Mtr pole	
8		Single Pole Mounted Transformer Kit for erection of Transformers on 11Mtr Spun Poles	
9		SPMT Materials for erection of transformer on 25/63kVA on 9mtr RCC/PSCC pole	
10		Guy set (Insulator & GI wire has to be purchased by BESCOM approved Vendors)	
11		G I Grounding Pipe B-class, 42mm Dia, 2.5mtrs long, 3.2mm thick with bolts & nuts, GI strip & washers complete	
12		11kV DP set	

**The approval is subject to the following conditions:-**

1. The prospective consumers who purchase above said material shall stand guarantee for the materials for a period of Five years from the date of commissioning.

2. The vendor shall furnish all the relevant valid type test reports as per BESCOM Technical specification & its amendment from time to time issued by M/s CPRI/ERDA or any Govt. lab/Testing houses only and Vendor approvals are considered based on type test reports as per circular cited reference (1).
3. All the components utilized for manufacturing above products has to be same as that of utilized in the type test sample.
4. The above materials shall be manufactured as per approved drawings (Please refer [www.bescom.karnataka.gov.in](http://www.bescom.karnataka.gov.in) for BESCOM approved drawings) and GTP & drawing approvals shall be obtained before suppliers are made.
5. GTP and Drawing approvals shall be obtained by the firm before offering for inspections.
6. The above materials shall be got inspected by QS&S or the concerned jurisdictional Engineers, BESCOM before they are put into service.
7. BESCOM reserves the right to call for any document/credentials for verification during drawing approvals/inspection of material/equipment by BESCOM authorities to ascertain the manufacturing experience/performance/technical suitability of the material. Further BESCOM reserves the right to withdraw/cancel the vendor approval issued, in case of any violation of the approved drawing and specification at any time, poor quality /defective materials/equipment to BESCOM projects, poor performance, poor after sales service, etc.
8. For renewal of vendor approval proposal shall be submitted one month prior to expiry of validity of vendor approval.

Approved by Director (Technical)

  
(T. S Chandran)  
General Manager (El.),  
Quality Standards and Safety,  
BESCOM.

Copy to-

1. The Chief General Manager, Operations/CA/Projects, BESCOM, Bangalore.
2. All the Chief Engineer(Electy.,) O&M Zones, BESCOM.
3. The General Manager (El.,) Procurement / DAS, BESCOM.
4. All Superintending Engineers (El.,), O&M Circle, BESCOM.
5. All Executive Engineers (Ele.) O&M Divisions, BESCOM.
6. PS to D (T) to place it before Director (Technical), BESCOM.
7. M/s Sri Ranganatha Agencies, Sy No:19/5, Ward No.2, Mavinakatte Post, Kunigal Taluk, Tumkur  
Dist - 572130 Ph No:9845896950/9886033267.
8. Office copy / M.F.



**BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED**  
(Wholly owned by Government of Karnataka Undertaking)

Telephone No. 080-22252128

E-Mail gmqs.work@gmail.com, gmqs@bescom.co.in

No: BESCOM/GM(Q,S&S)/AE/BC-11/21-22/

Encl:

O/o GM(QS&S)

Corporate Office, K.R. Circle

Bangalore-560 001

Date: 10.03.2022

**OFFICIAL MEMORANDUM FOR VENDOR APPROVAL**

Sub :	Renewal of Vendor approval for supply of 11kV HT Metering cubicle (3CT, 3PT) & 11kV 630A LBS Panel by M/s Star Switchgears, Bangalore
Ref :	1. CEA Guidelines for validity of type test reports vide OM No: GM(QS&S)/DGM(EI)-3/ BC-11/20-21/CYS-141 dtd:15.10.2020. 2. Firm Letter No. STR/2021-22/SM01 dtd:20.01.2022. 3. Approved by Director (Technical) vide para (10)/2815 dated: 10.03.2022 of T.O Note No: BESCOM/GM (QS&S)/AE/BC-11/2021-22/2449 dated: 03.03.2022.

\*\*\*\*\*

Approval is hereby accorded to the below mention firm as approved vendor to BESCOM for supply of the material to prospective consumers in BESCOM area for Electrification of layouts, M.S. Buildings, Action plan works, Self-execution works, Turnkey works & Partial Turnkey works etc.

Sl. No	Name of the Firm/ Address/Contact details	Equipment/Materials	Period of validity upto
1	M/s Star Switchgears, No: 14 & 15, 1 <sup>st</sup> Cross, 3 <sup>rd</sup> Main, Begur Cross Road, Bommanahalli, Bangalore-560068	11kV HT Metering cubicle (3CT, 3 PT)	28.04.2024
2	Ph No: 9880017373/9886655060 (E-mail:email@starswitchgears.in)	11kV 630A LBS Panel	15.03.2027 (Subject to revalidation once in 2 years)

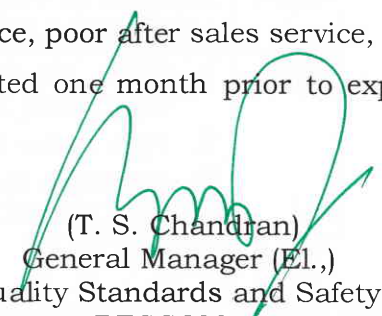
**The approval is subject to the following conditions:-**

1. The prospective consumers who purchase above said material shall stand guarantee for the materials for a period of Five years from the date of commissioning.
2. The vendor shall furnish all the relevant valid type test reports as per IS/IEC/BESCOM Technical specification & its amendment from time to time of not older than 5 years issued by M/s CPRI/ERDA or any Govt. lab/Testing houses only and Vendor approvals are considered based on type test reports.
3. All the components utilized for manufacturing above products has to be same as that of utilized in the type test sample.
4. The above materials shall be manufactured as per approved drawings (Please refer www.bescom.karnataka.gov.in for BESCOM approved drawings) and GTP & drawing approvals shall be obtained before supplies are made.



5. GTP and Drawing approvals shall be obtained by the firm before offering for inspections.
6. The above materials shall be got inspected by QS&S or the concerned jurisdictional Engineers, BESCO before they are put into service.
7. BESCO reserves the right to call for any document/credentials for verification during drawing approvals/inspection of material/equipment by BESCO authorities to ascertain the manufacturing experience/performance/technical suitability of the material. Further BESCO reserves the right to withdraw/cancel the vendor approval issued, in case of any violation of the approved drawing and specification at any time, poor quality /defective materials/equipment to BESCO projects, poor performance, poor after sales service, etc.
8. For renewal of vendor approval proposal shall be submitted one month prior to expiry of validity of vendor approval.

Approved by Director (Technical)

  
(T. S. Chandran)  
General Manager (El.)  
Quality Standards and Safety,  
BESCO.

**Copy for information to:**

1. The Chief General Manager, Operations/CA/Projects, BESCO, Bangalore
2. All the Chief Engineer (Electy..) O&M Zones, BESCO.
3. The General Manager (El.) Procurement / DAS, BESCO.
4. All Superintending Engineers (El.), O&M Circle, BESCO.
5. All Executive Engineers (Ele.) O&M Divisions, BESCO.
6. PS to D (T) to place it before Director (Technical), BESCO.
7. M/s Star Switchgears, No: 14 & 15, 1<sup>st</sup> Cross, 3<sup>rd</sup> Main, Begur Cross Road, Bommanahalli, Bangalore-560068 Ph No: 9880017373/9886655060 (E-mail:email@starswitchgears.in)
8. Office copy / M.F.



**BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED**  
(Wholly owned by Government of Karnataka Undertaking)

Telephone No. 080-22252128

E-Mail gmqs.work@gmail.com, gmqs@bescom.co.in

No: BESCOM/GM(Q,S&S)/AE/BC-11/21-22/45-173

Encl:

O/o GM(QS&S)

Corporate Office, K.R. Circle

Bangalore-560 001

Date: 18 MAR 2022

**OFFICIAL MEMORANDUM FOR VENDOR APPROVAL**

Sub :	Renewal of Vendor approval for supply of LT/HT Hardware Materials by M/s Sri Venkateshwara Electricals, Bangalore
Ref :	1. Firms letter No: NIL dated: 01.02.2022. 2. Approved by Director (Technical), BESCOM vide para(8)/2914 dated: 10.03.2022 of T.O note no: BESCOM/GM (QS&S)/AE/BC-11/21-22/2520 dated: 10.03.2022.

\*\*\*\*\*

Approval is hereby accorded to the below mention firm as approved vendor to BESCOM for supply of the material to prospective consumers in BESCOM area for Electrification of layouts, M.S. Buildings, Action plan works, Self-execution works, Turnkey works & Partial Turnkey works etc.

Sl. No	Name of the Firm/ Address/Contact details	Equipment/Materials (Hardware Line materials)	Period of validity upto
1	M/s Sri Venkateshwara Electricals, #3, 2 <sup>nd</sup> Cross, Yelenahalli, Begur Road, Bangalore- 560068. <b>Contact No:</b> 9945294639/9964051443 <b>Email:</b> venkateshwaraelectriclas123@ gmail.com	Four and Two pin cross arms	<b>18.03.2024</b>
2		11kV Special three pin cross arm	
3		11kV Horizontal cross arm	
4		LT & HT Single top support	
5		RCC/PSCC pole clamps	
6		Double Pole TC sets for erection of transformers of 25/63/100kVA & 100/300kVA on RCC/ PSCC 9Mtr pole	
7		Single Pole Mounted Transformer Kit for erection of Transformers on 11Mtr Spun Poles	
8		SPMT Materials for erection of transformer on 25/63kVA on 9mtr RCC/PSCC pole	
9		PG clamps	
10		Earth Guard stirrup	
11		H - frame for mounting GOS	
12		G I Grounding Pipe B-class, 42mm Dia, 2.5mtrs long, 3.2mm thick with bolts & nuts, GI strip & washers complete	
13		Guy set (Insulator & GI Wire has to be purchased by BESCOM approved vendors)	
14		GI Flat	

**The approval is subject to the following conditions:-**

1. The prospective consumers who purchase above said material shall stand guarantee for the materials for a period of Five years from the date of commissioning.
2. The vendor shall furnish all the relevant valid type test reports (as per BESCOM Technical specification & its amendment from time to time) issued by M/s CPRI/ERDA or any Govt. lab/Testing houses only and Vendor approvals are considered based on type test reports.
3. All the components utilized for manufacturing above products has to be same as that of utilized in the type test sample.
4. The above materials shall be manufactured as per approved drawings (Please refer [www.bescom.karnataka.gov.in](http://www.bescom.karnataka.gov.in) for BESCOM approved drawings) and GTP & drawing approvals shall be obtained before suppliers are made.
5. GTP and Drawing approvals shall be obtained by the firm before offering for inspections.
6. The above materials shall be got inspected by QS&S or the concerned jurisdictional Engineers, BESCOM before they are put into service.
7. BESCOM reserves the right to call for any document/credentials for verification during drawing approvals/inspection of material/equipment by BESCOM authorities to ascertain the manufacturing experience/performance/technical suitability of the material. Further BESCOM reserves the right to withdraw/cancel the vendor approval issued, in case of any violation of the approved drawing and specification at any time, poor quality /defective materials/equipment to BESCOM projects, poor performance, poor after sales service, etc.
8. For renewal of vendor approval proposal shall be submitted one month prior to expiry of validity of vendor approval.

Approved by Director (Technical)

(T. S. Chandran)  
General Manager (El.)  
Quality Standards and Safety,  
BESCOM.

Copy to-

1. The Chief General Manager, Operations/CA/Projects, BESCOM, Bangalore
2. All the Chief Engineer (Electy..) O&M Zones, BESCOM.
3. The General Manager (El.) Procurement / DAS, BESCOM.
4. All Superintending Engineers (El.), O&M Circle, BESCOM.
5. All Executive Engineers (Ele.) O&M Divisions, BESCOM.
6. PS to D (T) to place it before Director (Technical), BESCOM.
7. M/s Sri Venkateshwara Electricals, #3, 2<sup>nd</sup> Cross, Yelenahalli, Begur Road, Bangalore-560068. **Contact No:**9945294639/9964051443  
**Email:** venkateshwaraelectriclas123@ gmail.com.
8. Office copy / M.F.





**BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED**  
(Wholly owned by Government of Karnataka Undertaking)

Telephone No. 080-22252128,

E-Mail [gmqs.work@gmail.com](mailto:gmqs.work@gmail.com) , [gmqs@bescom.co.in](mailto:gmqs@bescom.co.in)

No: BESCOM/GM(QS&S)/AE/BC-11/21-22/*CYS-174*

Encl:

O/o GM(QS&S)

Corporate Office, K.R.

Circle, Bangalore-1

Date: *18/03/2022*

**CONDITIONAL OFFICIAL MEMORANDUM FOR VENDOR APPROVAL**

Sub :	Conditional Vendor approval to M/s SLV Transformer, Bangalore for supply of 63kVA star1 rated EEL-2/ 4star rated Distribution Transformer.
Ref :	1. CEA Guidelines for validity of type test reports vide OM No: GM(QS&S)/ DGM(EI)-3/BC-11/20-21/CYS-141 dtd:15.10.2020. 2. Approved by Director (Technical) vide para (22)/970 dtd: 12.08.2021 & vide para (30) of T.O Note No: GM (QS&S)/DGM-3/BC-11/20-21/1954 dtd: 05.03.2021. 3. Firm Letter No: NIL dtd:29.01.2022

\*\*\*\*\*

Approval is hereby accorded to the below mention firm as approved vendor to BESCOM for supply of the following material to prospective consumers in BESCOM area for Electrification of layouts, M.S. Buildings, Action plan works, Self-execution works, Turnkey works & Partial Turnkey works etc.

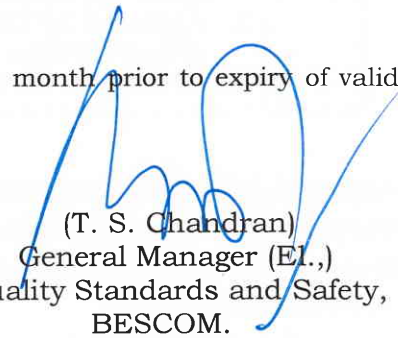
Sl No	Name of the Firm/ Address/ Contact details	Equipment/Materials	Period of validity upto
1	M/s SLV Transformer, Ground floor, Sy No.124, Near Abhaya School, Jangalpalya Village, Jigani Hobli Anekal Taluk, Bangalore - 560083 Ph No:9686661992/9448369932 E-mail: <a href="mailto:slvtransformer20@gmail.com">slvtransformer20@gmail.com</a>	63kVA star1 rated (EEL-2/4 star), Distribution Transformers, CRGO core, 50Hz, ONAN Cooled, complete with first filling EHV Grade Transformer Oil with all accessories and confirming to latest versions of IS - 1180 & IS - 2026. <b>(Star1 rated Distribution Transformers shall be used in Rural Area only)</b>	<b>18.06.2022</b>

**The approval is subject to the following conditions:-**

1. The prospective consumers who purchase above said material shall stand guarantee for the materials for a period of Five years from the date of commissioning.
2. All the components utilized for manufacturing above products has to be same as that of utilized in the type test sample.
3. The firm shall supply the Distribution Transformer only after conducting and submission of all the balance type tests as per IS/IEC/BESCOM specification and submitted before 18.06.2022 for further needful.
4. The above materials shall be manufactured as per approved drawings (Please refer [www.bescom.karnataka.gov.in](http://www.bescom.karnataka.gov.in) for BESCOM approved drawings) and GTP & drawing approvals shall be obtained before suppliers are made.
5. The vendor shall furnish all the relevant valid type test reports (as per BESCOM Technical specification& its amendment from time to time) issued by M/s CPRI/ERDA or any Govt. lab/Testing houses only.

6. GTP and Drawing approvals shall be obtained by the firm before offering for inspections.
7. The above materials shall be got inspected by QS&S or the concerned jurisdictional Engineers, BESCOM before they are put into service.
8. BESCOM reserves the right to call for any document/credentials for verification during drawing approvals/inspection of material/equipment by BESCOM authorities to ascertain the manufacturing experience/performance/technical suitability of the material. Further BESCOM reserves the right to withdraw/cancel the vendor approval issued, in case of any violation of the approved drawing and specification at any time, poor quality /defective materials/equipment to BESCOM projects, poor performance, poor after sales service, etc.
9. Stainless steel plate of 5" x 2" dimensions with unique ID code shall be welded on the tank of the transformer.
10. For renewal of vendor approval proposal shall be submitted one month prior to expiry of validity of vendor approval.

Approved by Director (Technical)

  
(T. S. Chandran)  
General Manager (El.,)  
Quality Standards and Safety,  
BESCOM.

Copy to-

1. The Chief General Manager, Operations/CA/Projects, BESCOM, Bangalore.
2. All the Chief Engineer(Electy.,) O&M Zones, BESCOM.
3. The General Manager (El.,) Procurement / DAS, BESCOM.
4. All Superintending Engineers (El.,), O&M Circle, BESCOM.
5. All Executive Engineers (Ele.) O&M Divisions, BESCOM.
6. PS to D (T) to place it before Director (Technical), BESCOM.
7. M/s SLV Transformer, Ground floor, Sy No.124, Near Abhaya School, Jangalpalya Village, Jigani Hobli Anekal Taluk, Bangalore - 560083 Ph No:9686661992/9448369932  
E-mail: slvtransformer20@gmail.com
8. Office copy / M.F.



**BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED**  
(Wholly owned by Government of Karnataka Undertaking)

Telephone No. 080-22252128

E-Mail [gmqs.work@gmail.com](mailto:gmqs.work@gmail.com), [gmqs@bescom.co.in](mailto:gmqs@bescom.co.in)

No: BESCOM/GM(Q,S&S)/AE/BC-11/21-22/ *CYS-175*

Encl:

O/o GM(QS&S)

Corporate Office, K.R. Circle

Bangalore-560 001

Date: *21/03/2022*

**OFFICIAL MEMORANDUM FOR VENDOR APPROVAL**

Sub :	Vendor approval for supply of LT/HT Line Hardware Materials & Structural Materials by M/s Pavan Engineering Works, Davangere.
Ref :	1. CEA Guidelines for validity of type test reports vide OM No: GM (QS&S)/ DGM(EI)-3/BC-11/20-21/CYS-141 dtd:15.10.2020. 2. Firms letter No: NIL dated: 17.01.2022. 3. Approved by Director (Technical), BESCOM vide para (12)/3047 dated: 21.03.2022 of T.O note no: BESCOM/ GM(QS&S)/AE/BC-11/21-22/2610 dated: 21.03.2022

\*\*\*\*\*

Approval is hereby accorded to the below mention firm as approved vendor to BESCOM for supply of the material to prospective consumers in BESCOM area for Electrification of layouts, M.S. Buildings, Action plan works, Self-execution works, Turnkey works & Partial Turnkey works etc.

Sl. No	Name of the Firm/ Address/Contact details	Equipment/Materials	Period of validity upto
1	M/s Pavan Engineering Works, SPL 5, KSSIDC Industrial Area, Lokikere Road, Opp Sumyuktha Karnataka Press, Davangere, Karnataka - 577005 Ph No: 9900174622 Email: <a href="mailto:chidihm@gmail.com">chidihm@gmail.com</a>	11kV Horizontal cross arm	<b>21.03.2024</b>
2		2 Pin & 4 Pin cross Arm	
3		11kV Special 3 Pin Cross Arms	
4		Clamps for PSCC/RCC poles	
5		LT & HT Single Top support	
6		Guy set (Insulator & GI wire has to be purchased by BESCOM approved Vendors)	
7		Turn Buckle & Eye Bolt	
8		Spiral Earth Electrode	
9		Single Pole Mounted Transformer Kit for erection of Transformers on 11Mtr Spun Poles	
10		SPMT Materials for erection of transformer on 25/63kVA on 9mtr RCC/PSCC pole	
11		Double Pole TC sets for erection of transformers of 25/63/100kVA & 100/300kVA on RCC/PSCC 9Mtr pole	
12		G I Grounding Pipe B-class, 42mm Dia, 2.5mtrs long, 3.2mm thick with bolts & nuts, GI strip & washers complete	
13		11kV DP set	
14		PG clamps	
15		1.1kV & 11kV GI Pin	

**Approval is subject to the following conditions:-**

1. The prospective consumers who purchase above said material shall stand guarantee for the materials for a period of Five years from the date of commissioning.
2. The vendor shall furnish all the relevant valid type test reports (as per BESCOM Technical specification & its amendment from time to time) issued by M/s CPRI/ERDA or any Govt. lab/Testing houses only and Vendor approvals are considered based on type test reports as per circular cited reference (1).
3. All the components utilized for manufacturing above products has to be same as that of utilized in the type test sample.
4. GTP and Drawing approvals shall be obtained by the firm before offering for inspections.
5. The above materials shall be manufactured as per approved drawings (Please refer [www.bescom.karnataka.gov.in](http://www.bescom.karnataka.gov.in) for BESCOM approved drawings) and GTP & drawing approvals shall be obtained before suppliers are made.
6. The above materials shall be got inspected by QS&S or the concerned jurisdictional Engineers, BESCOM before they are put into service.
7. BESCOM reserves the right to call for any document/credentials for verification during drawing approvals/inspection of material/equipment by BESCOM authorities to ascertain the manufacturing experience/performance/technical suitability of the material. Further BESCOM reserves the right to withdraw/cancel the vendor approval issued, in case of any violation of the approved drawing and specification at any time, poor quality /defective materials/equipment to BESCOM projects, poor performance, poor after sales service, etc.
8. For renewal of vendor approval proposal shall be submitted one month prior to expiry of validity of vendor approval.

Approved by Director (Technical)

(T.S. Chandran)  
General Manager (El.),  
Quality Standards and Safety,  
BESCOM.

Copy to-

1. The Chief General Manager, Operations/CA/Projects, BESCOM, Bangalore.
2. All the Chief Engineer(Electy.) O&M Zones, BESCOM.
3. The General Manager (El.) Procurement / DAS, BESCOM.
4. All Superintending Engineers (El.), O&M Circle, BESCOM.
5. All Executive Engineers (Ele.) O&M Divisions, BESCOM.
6. PS to D (T) to place it before Director (Technical), BESCOM.
7. M/s Pavan Engineering Works, SPL 5, KSSIDC Industrial Area, Lokikere Road, Opp Sumyuktha Karnataka Press, Davangere, Karnataka – 577005  
Ph No: 9900174622 Email: [chidihm@gmail.com](mailto:chidihm@gmail.com)
8. Office copy / M.F.



**BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED**  
(Wholly owned by Government of Karnataka Undertaking)

Telephone No. 080-22252128,

E-Mail [gmqs.work@gmail.com](mailto:gmqs.work@gmail.com) , [gmqs@bescom.co.in](mailto:gmqs@bescom.co.in)

No: BESCOM/GM(QS&S)/AE/BC-11/21-22/**CYS-176**

Encl:

O/o GM(QS&S)

Corporate Office, K.R. Circle

Bangalore-01

Date: 22/03/2022

**OFFICIAL MEMORANDUM FOR VENDOR APPROVAL**

Sub :	Vendor approval for supply of 63kVA & 100kVA star1 rated (EEL-2/4 star) & 200kVA star2 rated Distribution Transformer to M/s Venkat Switch gears, Bangalore.
Ref :	1. CEA Guidelines for validity of type test reports vide OM No: GM(QS&S)/DGM(EI)-3/ BC-11/20-21/CYS-141 dtd:15.10.2020 2. Firm Letter No: VSG/BESCOM/2021-22/006 dtd:25.06.2021 & VSG/BESCOM/2021-22/61 dtd: 03.03.2022. 3. Approved by Director (Technical) vide para (14)/2894 dtd: 10.03.2022 of T.O Note No: GM (QS&S)/DGM(EI)-3/BC-11/21-22/2500 dtd: 09.03.2022.

\*\*\*\*\*

Approval is hereby accorded to the below mention firm as approved vendor to BESCOM for supply of the material to prospective consumers in BESCOM area for Electrification of layouts, M.S. Buildings, Action plan works, Self-execution works, Turnkey works & Partial Turnkey works etc.

Sl. No	Name of the Firm/ Address/ Contact details	Equipment/Materials	Period of validity upto
1	M/s Venkat Switch gears, No.150, 10 <sup>th</sup> Main, 3 <sup>rd</sup> phase, Peenya Industrial Area, Bangalore - 560058 Ph No:080 23722274 E-mail: lakshmipathiad@venkatswitchgear.com	63kVA & 100kVA star1 rated (EEL-2/4 star), Distribution Transformers, 50Hz, CRGO Core, Aluminium wound, ONAN Cooled, complete with first filling EHV Grade Transformer Oil with all accessories and confirming to latest versions of IS - 1180 & IS - 2026. <b>(Star2 rated Distribution Transformers shall be used in Urban Area only)</b>	<b>28.02.2027</b> (Subject to revalidation once in 2 years)
2		200kVA, Star2 Rated (EEL-3/5star rated) Distribution Transformers, Aluminium wound & Copper wound, CRGO core, 50Hz, ONAN Cooled, complete with first filling EHV Grade Transformer Oil with all accessories and confirming to latest versions of IS - 1180 & IS - 2026. <b>(Star1 rated Distribution Transformers shall be used in Rural Area only)</b>	<b>11.07.2024</b> (Subject to revalidation once in 2 years)

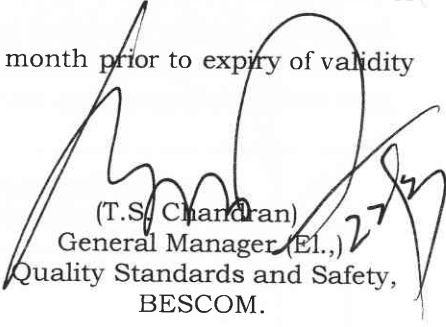
**The approval is subject to the following conditions:-**

1. This O.M is issued only to enlist the firm in vendor list of the BESCOM to manufacture the above star rated Distribution Transformers and the star marking on the product is liable to condition of BIS license and the firm shall produce the valid BIS license before supplies are made.
2. The prospective consumers who purchase above said material shall stand guarantee for the materials for a period of Five years from the date of commissioning.



3. All the components utilized for manufacturing above products has to be same as that of utilized in the type test sample.
4. The above materials shall be manufactured as per approved drawings (Please refer [www.bescom.karnataka.gov.in](http://www.bescom.karnataka.gov.in) for BESCOM approved drawings) and GTP & drawing approvals shall be obtained before suppliers are made.
5. The vendor shall furnish all the relevant valid type test reports (as per BESCOM Technical specification& its amendment from time to time) issued by M/s CPRI/ERDA or any Govt. lab/Testing houses only and Vendor approvals are considered based on type test reports as per circular cited reference (1).
6. GTP and Drawing approvals shall be obtained by the firm before offering for inspections.
7. The above materials shall be got inspected by QS&S or the concerned jurisdictional Engineers, BESCOM before they are put into service.
8. BESCOM reserves the right to call for any document/credentials for verification during drawing approvals/inspection of material/equipment by BESCOM authorities to ascertain the manufacturing experience/performance/technical suitability of the material. Further BESCOM reserves the right to withdraw/cancel the vendor approval issued, in case of any violation of the approved drawing and specification at any time, poor quality /defective materials/equipment to BESCOM projects, poor performance, poor after sales service, etc.
9. Stainless steel plate of 5" x 2" dimensions with unique ID code shall be welded on the tank of the transformer.
10. For renewal of vendor approval proposal shall be submitted one month prior to expiry of validity of vendor approval.

**Approved by Director (Technical)**

  
(T.S. Chandran)  
General Manager (El.),  
Quality Standards and Safety,  
BESCOM.

**Copy to-**

1. The Chief General Manager (El.) CA/Operations/Projects, BESCOM, Bangalore.
2. All the Chief Engineer (Electy.) O&M Zones, BESCOM.
3. The General Managers (Ele.) Procurement / DAS, BESCOM.
4. All the Superintending Engineers (Ele), CO&M circles, BESCOM.
5. All the Executive Engineers (Ele.) CO&M Divisions, BESCOM.
6. PS to DT to place before Hon'ble Director (Technical), BESCOM.
7. M/s Venkat Switch gears, No.150, 10<sup>th</sup> Main, 3<sup>rd</sup> phase, Peenya Industrial Area, Bangalore - 560058 Ph No:080 23722274 E-mail: [lakshmipathiad@venkatswitchgears.com](mailto:lakshmipathiad@venkatswitchgears.com)
8. OC/MF.



**BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED**  
(Wholly owned by Government of Karnataka Undertaking)

Telephone No. 080-22252128,

E-Mail [gmqs.work@gmail.com](mailto:gmqs.work@gmail.com) , [gmqs@bescom.co.in](mailto:gmqs@bescom.co.in)

No: BESCOM/GM(QS&S)/AE/BC-11/21-22/

Encl:

O/o GM (QS&S)

Corporate Office,

K.R. Circle, Bangalore-1

Date: 22/03/2022

**OFFICIAL MEMORANDUM FOR VENDOR APPROVAL**

Sub :	Vendor approval for supply of 11Mtr PSCC Circular Spun pole – 500kgs WL to M/s Ashodaya Cement Products, Bangalore.
Ref :	1. CEA Guidelines for validity of type test reports vide OM No: GM(QS&S)/DGM(EI)-3/ BC-11/20-21/CYS-141 dtd:15.10.2020. 2. Firm Letter No: ACP/GM(QS&S)/VENDOR APPROVAL/20-21 Dated: 04.03.2022. 3. Approved by Director (Technical) vide para (11)/3012 dtd: 17.03.2022 of T.O Note No: GM (QS&S)/DGM-3/BC-11/21-22/2565 dtd: 16.03.2022.

\*\*\*\*\*

Approval is hereby accorded to the below mention firm as approved vendor to BESCOM for supply of the following materials to prospective consumers in BESCOM area for Electrification of layouts, M.S. Buildings, Action plan works, Self-execution works, Turnkey works & Partial Turnkey works etc.

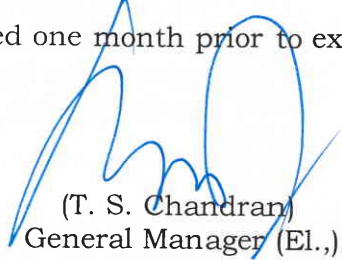
Sl. No	Name of the Firm/ Address/Contact details	Equipment/Materials	Period of validity upto
1	M/s Ashodaya Cement Products, Sy No: 60, Sonnenahalli Village, Kunda Hobli, Devanahalli Taluk, Bangalore Rural, Bangalore- 562110 Ph No: 9844104783, 9945222421 & 9739104783	11Mtr PSCC Circular Spun pole – 500kgs WL	28.02.2027 (Subject to first revalidation dated before <b>21.03.2023</b> and then it will be revalidated once in 2 years)

**The approval is subject to the following conditions:-**

1. The prospective consumers who purchase above said material shall stand guarantee for the materials for a period of Five years from the date of commissioning.
2. The vendor shall furnish all the relevant valid type test reports (as per BESCOM Technical specification & its amendment from time to time) issued by M/s CPRI/ERDA or any Govt. lab/Testing houses only and Vendor approvals are considered based on type test reports as per circular cited reference (1).
3. All the components utilized for manufacturing above products has to be same as that of utilized in the type test sample.
4. The above materials shall be manufactured as per approved drawings (Please refer [www.bescom.karnataka.gov.in](http://www.bescom.karnataka.gov.in) for BESCOM approved drawings) and GTP & drawing approvals shall be obtained before suppliers are made.
5. GTP and Drawing approvals shall be obtained by the firm before offering for inspections.

6. The above materials shall be got inspected by QS&S or the concerned jurisdictional Engineers, BESCOM before they are put into service.
7. BESCOM reserves the right to call for any document/credentials for verification during drawing approvals/inspection of material/equipment by BESCOM authorities to ascertain the manufacturing experience/performance/technical suitability of the material. Further BESCOM reserves the right to withdraw/cancel the vendor approval issued, in case of any violation of the approved drawing and specification at any time, poor quality /defective materials/equipment to BESCOM projects, poor performance, poor after sales service, etc.
8. For renewal of vendor approval proposal shall be submitted one month prior to expiry of validity of vendor approval.

Approved by Director (Technical)

  
(T. S. Chandran)  
General Manager (El.,)  
Quality Standards and Safety,  
BESCOM.

**Copy for information to:**

1. The Chief General Manager, Operations/CA/Projects, BESCOM, Bangalore
2. All the Chief Engineer (Electy..) O&M Zones, BESCOM.
3. The General Manager (El.,) Procurement / DAS, BESCOM.
4. All Superintending Engineers (El.), O&M Circle, BESCOM.
5. All Executive Engineers (Ele.) O&M Divisions, BESCOM.
6. PS to D (T) to place it before Director (Technical), BESCOM.
7. M/s Ashodaya Cement Products, Sy No: 60, Sonnenahalli Village, Kunda Hobli, Devanahalli Taluk, Bangalore Rural, Bangalore-562110  
Ph No: 9844104783, 9945222421 & 9739104783
8. Office copy /M.F.



**BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED**  
(Wholly owned by Government of Karnataka Undertaking)

Telephone No. 080-22252128

E-Mail [gmqs.work@gmail.com](mailto:gmqs.work@gmail.com), [gmqs@bescom.co.in](mailto:gmqs@bescom.co.in)

No: BESCOM/GM(Q,S&S)/AE/BC-11/21-22/45-178

Encl:

O/o GM(QS&S)

Corporate Office, K.R. Circle

Bangalore-560 001

Date: 23/03/2022

**OFFICIAL MEMORANDUM FOR VENDOR APPROVAL**

Sub :	Vendor approval for supply of LT/HT Line Hardware Materials & Structural Materials by M/s Ratan Projects & Engineering Co. Pvt Ltd, Bangalore.
Ref :	1. CEA Guidelines for validity of type test reports vide OM No: GM (QS&S)/ DGM(EI)-3/BC-11/20-21/CYS-141 dtd:15.10.2020. 2. Firms letter No: RPECPL/20-21/BESCOM/01 dated: 04.01.2021. 3. Approved by Director (Technical), BESCOM vide para (13)/2943 dated: 14.03.2022 of T.O note no: GM (QS&S)/DGM-3/BC-11/21-22/2530 dated: 14.02.2022

\*\*\*\*\*

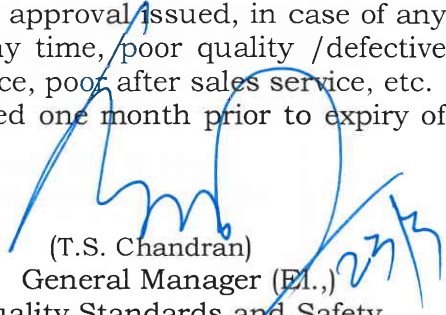
Approval is hereby accorded to the below mention firm as approved vendor to BESCOM for supply of the material to prospective consumers in BESCOM area for Electrification of layouts, M.S. Buildings, Action plan works, Self-execution works, Turnkey works & Partial Turnkey works etc.

Sl. No	Name of the Firm/ Address/Contact details	Equipment/Materials	Period of validity upto
1	M/s Ratan Projects & Engineering Co., Pvt Ltd Sankrail Industrial Park, village Bhagabatipur, Mouza Dist, Howrah - 711313 Ph No: 9830177331 E-mail: mahesh@ratans.com	11kV Horizontal cross arm	23.03.2023
2		2 Pin & 4 Pin cross Arm	
3		11kV Special 3 Pin Cross Arms	
4		LT & HT Single top support	
5		Single Pole Mounted Transformer Kit for erection of Transformers on 11Mtr Spun Poles	
6		SPMT Materials for erection of transformer on 25/63kVA on 9mtr RCC/PSCC pole	
7		Double Pole TC sets for erection of transformers of 25/63/100kVA & 100/300kVA on RCC/PSCC 9Mtr pole	
8		11kV DP set	
9		Copper Lugs/Aluminium Lugs	
10		Clamps for PSCC/RCC poles	
11		H- frame set for fixing GOS	
12		G I Grounding Pipe B-class, 42mm Dia, 2.5mtrs long, 3.2mm thick with bolts & nuts, GI strip & washers complete	
13		Danger Board	
14		Spacers for DTC wiring	
15		Anti-climbing devices	
16		Rod type of earthing using 40mm dia, 3mtr long MS rod as ground rod, in earth pit of 300mm width and 3300mm depth and using 50x6mm flat welded to ground rod as terminal & connected to equipment ground terminal using PVC Al wire as specified	
17		GI Flat	
18		3 GOS Frame set for Spun pole with & without transformers seating	

**Approval is subject to the following conditions:-**

1. The prospective consumers who purchase above said material shall stand guarantee for the materials for a period of Five years from the date of commissioning.
2. The vendor shall furnish all the relevant valid type test reports (as per BESCOM Technical specification& its amendment from time to time) issued by M/s CPRI/ERDA or any Govt. lab/Testing houses only and Vendor approvals are considered based on type test reports as per circular cited reference (1).
3. All the components utilized for manufacturing above products has to be same as that of utilized in the type test sample.
4. GTP and Drawing approvals shall be obtained by the firm before offering for inspections.
5. The above materials shall be manufactured as per approved drawings (Please refer [www.bescom.karnataka.gov.in](http://www.bescom.karnataka.gov.in) for BESCOM approved drawings) and GTP & drawing approvals shall be obtained before suppliers are made.
6. The above materials shall be got inspected by QS&S or the concerned jurisdictional Engineers, BESCOM before they are put into service.
7. BESCOM reserves the right to call for any document/credentials for verification during drawing approvals/inspection of material/equipment by BESCOM authorities to ascertain the manufacturing experience/performance/technical suitability of the material. Further BESCOM reserves the right to withdraw/cancel the vendor approval issued, in case of any violation of the approved drawing and specification at any time, poor quality /defective materials/equipment to BESCOM projects, poor performance, poor after sales service, etc.
8. For renewal of vendor approval proposal shall be submitted one month prior to expiry of validity of vendor approval.

Approved by Director (Technical)

  
(T.S. Chandran)  
General Manager (El.),  
Quality Standards and Safety,  
BESCOM.

Copy to-

1. The Chief General Manager, Operations/CA/Projects, BESCOM, Bangalore.
2. All the Chief Engineer(Electy.), O&M Zones, BESCOM.
3. The General Manager (El.) Procurement / DAS, BESCOM.
4. All Superintending Engineers (El.), O&M Circle, BESCOM.
5. All Executive Engineers (Ele.) O&M Divisions, BESCOM.
6. PS to D (T) to place it before Director (Technical), BESCOM.
7. M/s Ratan Projects & Engineering Co., Pvt Ltd Sankrail Industrial Park, village Bhagabatipur, Mouza Dist, Howrah - 711313 Ph No: 9830177331E-mail: mahesh@ratans.com
8. Office copy / M.F.





**BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED**  
(Wholly owned by Government of Karnataka Undertaking)

Telephone No. 080-22252128

E-Mail: gmqs.work@gmail.com, gmqs@bescom.co.in

No: BESCOM/GM(Q,S&S)/AE/BC-11/21-22/CYS-179

Encl:

O/o GM (QS&S)

Corporate Office, K.R. Circle

Bangalore-560 001

Date: 30/03/2022

**OFFICIAL MEMORANDUM FOR VENDOR APPROVAL**

Sub :	Renewal of Vendor approval for supply of LT/HT Line Hardware Materials & Structural Materials by M/s ARS Industries, Bangalore.
Ref :	1. CEA Guidelines for validity of type test reports vide OM No: GM (QS&S)/ DGM(EI)-3/BC-11/20-21/CYS-141 dtd:15.10.2020. 2. Firms letter No: NIL dated: 19.03.2022. 3. Approved by Director (Technical), BESCOM vide para (8)/3138 dated: 28.03.2022 of T.O note no: BESCOM/GM (QS&S)/AE/BC-11/21-22/2676 dated: 28.03.2022.

\*\*\*\*\*

Approval is hereby accorded to the below mention firm as approved vendor to BESCOM for supply of the material to prospective consumers in BESCOM area for Electrification of layouts, M.S. Buildings, Action plan works, Self-execution works, Turnkey works & Partial Turnkey works etc.

Sl. No	Name of the Firm/ Address/Contact details	Equipment/Materials	Period of validity upto
1	M/s ARS Industries, No.23 & 24, Ramanashree Lake Gardens, Maranayakanahalli, Jala Hobli, Chikkajala, Bangalore North - 562157 Ph No: 9880750750/9900480781 E-mail: arsindustries16@gmail.com	11kV Horizontal cross arm	29.03.2024
2		2 Pin & 4 Pin cross Arm	
3		11kV Special 3 Pin Cross Arms	
4		Single Pole Mounted Transformer Kit for erection of Transformers on 11Mtr Spun Poles	
5		SPMT Materials for erection of transformer on 25/63kVA on 9mtr RCC/PSCC pole	
6		Guy set (Insulator & GI wire has to be purchased by BESCOM approved Vendors)	
7		G.I.Pipe B-class as per IS-1239	
8		Alkathine Tubes	
9		11kV DP set	
10		Copper Lugs	
11		PG Clamps	
12		Clamps for PSCC/RCC poles	
13		H- frame set for fixing GOS	
14		G I Grounding Pipe B-class, 42mm Dia, 2.5mtrs long, 3.2mm thick with bolts & nuts, GI strip & washers complete	
15		Earthing Materials pipe type for grounding	
16		Danger Board	
17		Fish Plate	
18		Spiral Earth Electrode	

19	M/s ARS Industries,	Tee - Connectors - KZ3 95	<b>29.03.2024</b>
20	No.23 & 24, Ramanashree Lake Gardens,	Pre - Insulated Lugs - CPTAU for 95 Sqmm	
21	Maranayakanahalli, Jala	End Cap for 50/70 Sqmm	
22	Hobli, Chikkajala, Bangalore North - 562157 Ph No: 9880750750/9900480781 E-mail: arindustries16@gmail.com	Double Pole TC sets for erection of transformers of 25/63/100kVA & 100/300kVA on RCC/PSCC 9Mtr pole	

**Approval is subject to the following conditions:-**

1. The prospective consumers who purchase above said material shall stand guarantee for the materials for a period of Five years from the date of commissioning.
2. The vendor shall furnish all the relevant valid type test reports (as per BESCOM Technical specification& its amendment from time to time) issued by M/s CPRI/ERDA or any Govt. lab/Testing houses only and Vendor approvals are considered based on type test reports as per circular cited reference (1).
3. All the components utilized for manufacturing above products has to be same as that of utilized in the type test sample.
4. GTP and Drawing approvals shall be obtained by the firm before offering for inspections.
5. The above materials shall be manufactured as per approved drawings (Please refer [www.bescom.karnataka.gov.in](http://www.bescom.karnataka.gov.in) for BESCOM approved drawings) and GTP & drawing approvals shall be obtained before suppliers are made.
6. The above materials shall be got inspected by QS&S or the concerned jurisdictional Engineers, BESCOM before they are put into service.
7. BESCOM reserves the right to call for any document/credentials for verification during drawing approvals/inspection of material/equipment by BESCOM authorities to ascertain the manufacturing experience/performance/technical suitability of the material. Further BESCOM reserves the right to withdraw/cancel the vendor approval issued, in case of any violation of the approved drawing and specification at any time, poor quality /defective materials/equipment to BESCOM projects, poor performance, poor after sales service, etc.
8. For renewal of vendor approval proposal shall be submitted one month prior to expiry of validity of vendor approval.

Approved by Director (Technical)

  
 (T.S. Chandran)  
 General Manager (El.)  
 Quality Standards and Safety,  
 BESCOM.

**Copy to-**

1. The Chief General Manager, Operations/CA/Projects, BESCOM, Bangalore.
2. All the Chief Engineer(Electy..) O&M Zones, BESCOM.
3. The General Manager (El.) Procurement / DAS, BESCOM.
4. All Superintending Engineers (El.), O&M Circle, BESCOM.
5. All Executive Engineers (Ele.) O&M Divisions, BESCOM.
6. PS to D (T) to place it before Director (Technical), BESCOM.
7. M/s ARS Industries, No.23 & 24, Ramanashree Lake Gardens, Maranayakanahalli, Jala Hobli, Chikkajala, Bangalore North - 562157 Ph No: 9880750750/9900480781  
E-mail: arindustries16@gmail.com
8. Office copy / M.F.



# BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED

(Wholly owned by Government of Karnataka Undertaking)

Telephone No. 080-22252128,

E-Mail [gmqs.work@gmail.com](mailto:gmqs.work@gmail.com), [gmqs@bescom.co.in](mailto:gmqs@bescom.co.in)

No: BESCOM/GM(QS&S)/AE/BC-11/2021-22/45-180

Encl:

O/o GM (QS&S)

Corporate Office, K.R. Circle

Bangalore-560 001

Date: 30/03/2022

## OFFICIAL MEMORANDUM FOR VENDOR APPROVAL

Sub : Renewal of Vendor approval to M/s SLV Transformer, Bangalore for supply of 25kVA, star1 rated (EEL-2/4Star rated), 100kVA & 250kVA star2 rated (EEL-3/5Star) Distribution Transformer.

- Ref: 1. CEA Guidelines for validity of type test reports vide OM No: GM(QS&S)/DGM(EI)-3/BC-11/20-21/CYS-141 dtd:15.10.2020.  
2. Firm Letter No: Slv/Trans/003/21-22 dated: 18.03.2022.  
3. Approved by Director (Technical) vide para (35)/3112 dtd: 24.03.2022 of T.O Note No: GM (QS&S)/DGM-3/BC-11/20-21/1954 dtd: 05.03.2021.

\*\*\*\*\*

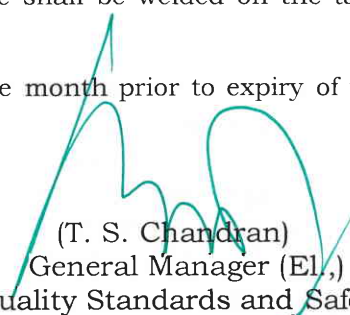
Approval is hereby accorded to the below mention firm as approved vendor to BESCOM for supply of the following material to prospective consumers in BESCOM area for Electrification of layouts, M.S. Buildings, Action plan works, Self-execution works, Turnkey works & Partial Turnkey works etc.

Sl No	Name of the Firm/ Address/ Contact details	Equipment/Materials	Period of validity upto
1		25kVA, Star1Rated (EEL-2/4star rated) Distribution Transformers, 50Hz, CRGO Core, Aluminium Wound, ONAN Cooled, complete with first filling EHV Grade Transformer Oil with all accessories and confirming to latest versions of IS - 1180 & IS - 2026. <b>(Star1 rated Distribution Transformers shall be used in Rural Area only)</b>	<b>16.02.2026</b> (Subject to revalidation once in 2 years)
2	M/s SLV Transformer, Ground floor, Sy No.124, Near Abhaya School, Jangalpalya Village, Jigani Hobli Anekal Taluk, Bangalore - 560083 Ph No:9686661992/9448369932 E-mail: slvtransformer20@gmail.com	100kVA, Star2Rated (EEL-3/5star rated) Distribution Transformers, CRGO Core, Aluminium wound 50Hz, ONAN Cooled, complete with first filling EHV Grade Transformer Oil with all accessories and confirming to latest versions of IS - 1180 & IS - 2026. <b>(Star2 rated Distribution Transformers shall be used in Urban Area only)</b>	<b>25.11.2025</b> (Subject to revalidation once in 2 years)
3		250kVA,Star2 Rated(EEL-3/5star rated), Distribution Transformers, 50Hz, CRGO Core, Aluminium Wound, ONAN Cooled, complete with first filling EHV Grade Transformer Oil with all accessories and confirming to latest versions of IS - 1180 & IS - 2026. <b>(Star2 rated Distribution Transformers shall be used in Urban Area only)</b>	<b>08.02.2026</b> (Subject to revalidation once in 2 years)

**The approval is subject to the following conditions:-**

1. This O.M is issued only to enlist the firm in vendor list of the BESCO to manufacture the above star rated Distribution Transformers and the star marking on the product is liable to condition of BIS license and the firm shall produce the valid BIS license before supplies are made.
2. The prospective consumers who purchase above said material shall stand guarantee for the materials for a period of Five years from the date of commissioning.
3. All the components utilized for manufacturing above products has to be same as that of utilized in the type test sample.
4. The above materials shall be manufactured as per approved drawings (Please refer [www.bescom.karnataka.gov.in](http://www.bescom.karnataka.gov.in) for BESCO approved drawings) and GTP & drawing approvals shall be obtained before suppliers are made.
5. The vendor shall furnish all the relevant valid type test reports (as per BESCO Technical specification& its amendment from time to time) issued by M/s CPRI/ERDA or any Govt. lab/Testing houses only and Vendor approvals are considered based on type test reports as per circular cited reference (1).
6. GTP and Drawing approvals shall be obtained by the firm before offering for inspections.
7. The above materials shall be got inspected by QS&S or the concerned jurisdictional Engineers, BESCO before they are put into service.
8. BESCO reserves the right to call for any document/credentials for verification during drawing approvals/inspection of material/equipment by BESCO authorities to ascertain the manufacturing experience/performance/technical suitability of the material. Further BESCO reserves the right to withdraw/cancel the vendor approval issued, in case of any violation of the approved drawing and specification at any time, poor quality /defective materials/equipment to BESCO projects, poor performance, poor after sales service, etc.
9. Stainless steel plate of 5" x 2" dimensions with unique ID code shall be welded on the tank of the transformer.
10. For renewal of vendor approval proposal shall be submitted one month prior to expiry of validity of vendor approval.

Approved by Director (Technical)

  
(T. S. Chandran)  
General Manager (El.,)  
Quality Standards and Safety,  
BESCO.

**Copy to-**

1. The Chief General Manager, Operations/CA/Projects, BESCO, Bangalore.
2. All the Chief Engineer(Electy.) O&M Zones, BESCO.
3. The General Manager (El.) Procurement / DAS, BESCO.
4. All Superintending Engineers (El.), O&M Circle, BESCO.
5. All Executive Engineers (Ele.) O&M Divisions, BESCO.
6. PS to D (T) to place it before Director (Technical), BESCO.
7. M/s SLV Transformer, Ground floor, Sy No.124, Near Abhaya School, Jangalpalya Village, Jigani Hobli Anekal Taluk, Bangalore - 560083 Ph No:9686661992/9448369932  
E-mail: [slvtransformer20@gmail.com](mailto:slvtransformer20@gmail.com)
8. Office copy / M.F.





# BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED

(Wholly owned by Government of Karnataka Undertaking)

Telephone No. 080-22252128,

E-Mail: gmqs.work@gmail.com,

No: BESCOM/GM(Q, S&S)/AE/BC-11/21-22/ ) CYS-181

Encl:

O/o GM(QS&S)

Corporate Office, K.R. Circle

Bangalore-560 001

Date: 30 MAR 2022

## OFFICIAL MEMORANDUM FOR VENDOR APPROVAL

Sub : Vendor approval for supply of GI grounding pipe & GI Pipe by M/s Pipe Corporation Private Limited, Bangalore.

Ref : 1. Firm Ltr No: PPCL:22-23:GM(Q&S) BESCOM:556 dtd: 05.03.2022.  
2. Approved by Director (Technical) vide para(14)/3109 dtd:24.03.2022 of T.O Note No: GM(QS&S)/DGM-3/BC-11/21-22/2624 dated: 21.03.2022.

\*\*\*\*\*

Approval is hereby accorded to the below mention firm as approved vendor to BESCOM for supply of the material to prospective consumers in BESCOM area for Electrification of layouts, M.S. Buildings, Action plan works, Self-execution works, Turnkey works & Partial Turnkey works etc.

Sl. No	Name of the Firm/ Address/Contact details	Equipment/Materials	Period of validity upto
1	M/s Pipe Corporation Private Limited, No.6/3, 4th cross, Labagh Road, K.S. Garden, Bangalore & Registered office: No.164 (old 54/19), 4th cross, Labagh, Bangalore-560027	GI Grounding Pipe B-class, 42mm Dia, 2.5mtrs long, 3.2mm thick with bolts & nuts, GI strip & washers complete	30.03.2024
2	Tel: 080-41145615, 22240615, 080-41240615/22279017 E-mail: pipecorp1933@gmail.com/ pipecorporation@gmail.com	GI Pipe B-class as per IS-1239 (Ranging from 20mm to 150mm Dia)	

### Approval is subject to the following conditions:-

1. The prospective consumers who purchase above said material shall stand guarantee for the materials for a period of Five years from the date of commissioning.
2. The vendor shall furnish all the relevant valid type test reports (as per BESCOM Technical specification & its amendment from time to time) issued by M/s CPRI/ERDA or any Govt. lab/Testing houses only and Vendor approvals are considered based on type test reports as per circular cited reference (1).
3. All the components utilized for manufacturing above products has to be same as that of utilized in the type test sample.
4. GTP and Drawing approvals shall be obtained by the firm before offering for inspections.
5. The above materials shall be manufactured as per approved drawings (Please refer www.bescom.karnataka.gov.in for BESCOM approved drawings) and GTP & drawing approvals shall be obtained before suppliers are made.
6. The above materials shall be got inspected by QS&S or the concerned jurisdictional Engineers, BESCOM before they are put into service.



7. BESCO reserves the right to call for any document/credentials for verification during drawing approvals/inspection of material/equipment by BESCO authorities to ascertain the manufacturing experience/performance/technical suitability of the material. Further BESCO reserves the right to withdraw/cancel the vendor approval issued, in case of any violation of the approved drawing and specification at any time, poor quality /defective materials/equipment to BESCO projects, poor performance, poor after sales service, etc.
8. For renewal of vendor approval proposal shall be submitted one month prior to expiry of validity of vendor approval.

Approved by Director (Technical)

  
(T.S. Chandran)  
General Manager (El.)  
Quality Standards and Safety,  
BESCO.

**Copy to-**

1. The Chief General Manager (El.) CA/Operations/Projects, BESCO, Bangalore.
2. All the Chief Engineer (Electy.), O&M Zones, BESCO.
3. The General Managers (Ele.) Procurement / DAS, BESCO.
4. All the Superintending Engineers (Ele), CO&M circles, BESCO.
5. All the Executive Engineers (Ele.) CO&M Divisions, BESCO.
6. PS to DT to place before Hon'ble Director (Technical), BESCO.
7. M/s Pipe Corporation Private Limited, No.6/3, 4th cross, Lalbagh Road, K.S. Garden, Bangalore.  
Contact No: 080-41145615, 22240615, 080-41240615/22279017  
E-mail: pipecorp1933@gmail.com/pipecorporation@gmail.com
8. Office copy/M.F.



# BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED

(Wholly owned by Government of Karnataka Undertaking)

Telephone No. 080-22252128,

E-Mail: gmqs.work@gmail.com,

No: BESCOM/GM(Q, S&S)/AE/BC-11/21-22/CYS-182

Encl:

O/o GM(QS&S)

Corporate Office, K.R. Circle

Bangalore-560 001

Date:

30 MAR 2022

## OFFICIAL MEMORANDUM FOR VENDOR APPROVAL

Sub : Vendor approval for supply of HT/LT Line materials by M/s R K Infra Electricals Private Limited, Bengaluru.

Ref : 1. Firm Ltr No: RKIEPL/BESCOM/1903/2022 dated: 19.03.2022.

2. Approved by Director (Technical) vide para(9)/3149 dtd:28.03.2022 of T.O Note No: GM(QS&S)/DGM-3/BC-11/21-22/2668 dated: 28.03.2022.

\*\*\*\*\*

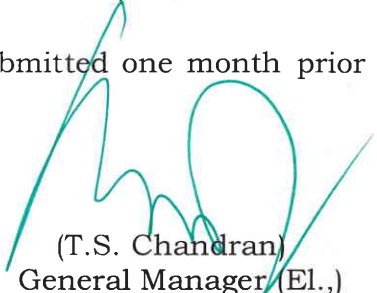
Approval is hereby accorded to the below mention firm as approved vendor to BESCOM for supply of the material to prospective consumers in BESCOM area for Electrification of layouts, M.S. Buildings, Action plan works, Self-execution works, Turnkey works & Partial Turnkey works etc.

Sl. No	Name of the Firm/ Address/Contact details	Equipment/Materials (Hardware Line materials)	Period of validity upto
1	M/s R K Infra Electricals Private Limited, No.8/1, 1 <sup>st</sup> Main Road, Sultanpalya, R.T. Nagar Post, Bengaluru. <b>(Factory Unit: No. S-46, 1<sup>st</sup> phase, Apparel Park, KIADB Industrial area, Doddaballapura - 561203)</b> (Mobile:918023336824, 9844044346, 9986552571) (E-mail:zkinfra1987@gmail.com, rkwatts1961@gmail.com)	11kV Horizontal cross arm	30.03.2023
2		11kV Special three pin cross arm	
3		Four and Two pin cross arms	
4		RCC/PSCC pole clamps	
5		Guy set (Insulator & GI wire has to be purchased by BESCOM approved Vendors)	
6		LT & HT single top support	
7		EG Stirrups	
8		Double Pole TC sets for erection of transformers of 25/63/100kVA & 100/300kVA on RCC/PSCC 9Mtr pole	
9		H Frame set for mounting GOS	
10		Fish plate	
11		SPMT Materials for erection of transformer on 25/63kVA on 9mtr RCC/PSCC pole	
12		Single Pole Mounted Transformer Kit for erection of Transformers on 11Mtr Spun Poles	
13		GI Grounding Pipe B-class, 42mm Dia, 2.5mtrs long, 3.2mm thick with bolts & nuts, GI strips and washers complete	
14		PG clamps	
15		Danger Board	
16		Anti-climbing device	
17		Alkathine tubes	
18		Spiral Earth Electrode	
19		Copper & Aluminium Lugs	
20		1& 3 GOS system with & without transformer seating	

**Approval is subject to the following conditions:-**

1. The prospective consumers who purchase above said material shall stand guarantee for the materials for a period of Five years from the date of commissioning.
2. The vendor shall furnish all the relevant valid type test reports (as per BESCOM Technical specification & its amendment from time to time) issued by M/s CPRI/ERDA or any Govt. lab/Testing houses only and Vendor approvals are considered based on type test reports as per circular cited reference (1).
3. All the components utilized for manufacturing above products has to be same as that of utilized in the type test sample.
4. GTP and Drawing approvals shall be obtained by the firm before offering for inspections.
5. The above materials shall be manufactured as per approved drawings (Please refer [www.bescom.karnataka.gov.in](http://www.bescom.karnataka.gov.in) for BESCOM approved drawings) and GTP & drawing approvals shall be obtained before suppliers are made.
6. The above materials shall be got inspected by QS&S or the concerned jurisdictional Engineers, BESCOM before they are put into service.
7. BESCOM reserves the right to call for any document/credentials for verification during drawing approvals/inspection of material/equipment by BESCOM authorities to ascertain the manufacturing experience/performance/technical suitability of the material. Further BESCOM reserves the right to withdraw/cancel the vendor approval issued, in case of any violation of the approved drawing and specification at any time, poor quality /defective materials/equipment to BESCOM projects, poor performance, poor after sales service, etc.
8. For renewal of vendor approval proposal shall be submitted one month prior to expiry of validity of vendor approval.

Approved by Director (Technical)

  
(T.S. Chandran)  
General Manager (El.),  
Quality Standards and Safety,  
BESCOM.

**Copy to-**

1. The Chief General Manager (El.) CA/Operations/Projects, BESCOM, Bangalore.
2. All the Chief Engineer (Electy.) O&M Zones, BESCOM.
3. The General Managers (Ele.) Procurement / DAS, BESCOM.
4. All the Superintending Engineers (Ele), CO&M circles, BESCOM.
5. All the Executive Engineers (Ele.) CO&M Divisions, BESCOM.
6. PS to DT to place before Hon'ble Director (Technical), BESCOM.
7. M/s R K Infra Electricals Private Limited, No.8/1, 1<sup>st</sup> Main Road, Sultanpalya, R.T. Nagar Post, Bengaluru. (**Factory Unit:** No. S-46, 1<sup>st</sup> phase, Apparel Park, KIADB Industrial area, Doddaballapura - 561203).  
(Mobile:918023336824, 9844044346, 9986552571)  
(E-mail:rkinfra1987@gmail.com, rkwatts1961@gmail.com)
8. Office copy/M.F.



# BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED

(Wholly owned by Government of Karnataka Undertaking)

Telephone No. 080-22252128

E-Mail [gmqs.work@gmail.com](mailto:gmqs.work@gmail.com), [gmqs@bescom.co.in](mailto:gmqs@bescom.co.in)

No: BESCOM/GM(Q,S&S)/AE/BC-11/21-22/45-183

Encl:

O/o GM(QS&S)

Corporate Office, K.R. Circle

Bangalore-560 001

Date: 31/03/2022

## OFFICIAL MEMORANDUM

Sub : Revalidation of vendor approval for supply of Polymeric lightning arrester, 11kV, 70kN Polymeric Disc Insulator, 11kV, 5kN Composite Polymeric Pin Insulator & 45kN Composite Polymeric Disc Insulator.

Ref : 1. T.O OM No. GM(QS&S)DGM(El.,)-4/BC-11/17-18/Cys-268 Dtd: 09.02.2018 & GM(QS&S)/DGM-3/BC-11/19-20/CYS-42 dtd:06.06.2019  
2. Firm letter No: NIL dtd: 15.09.2021.  
3. Approved by Director (Technical), BESCOM vide para (16)/3111 dated: 24.03.2022 of T.O note no: GM (QS&S)/DGM-3/BC-11/21-22/1202 dated: 04.10.2021.

\*\*\*\*\*

In the O.M. cited under reference (1), vendor approval has been accorded to M/s Navitas Insulators Private Limited, Plot No:49, Road No.6, 3<sup>rd</sup> Phase, Obadenahalli Industrial Area, Doddaballapur, Bangalore – 562163 subject to revalidation.

The firm has paid the processing fees of Rs.11, 800/- vide Receipt No. 4928/30 Dated: 01.10.2021.

After due verification of the certificates furnished by the firm, the vendor approval for supply of the following material is revalidated as mentioned below,

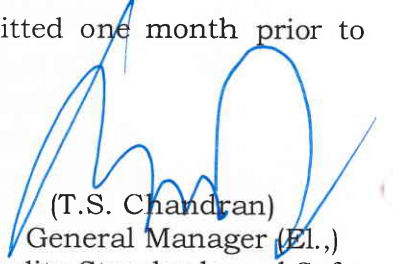
Sl. No.	Particulars	Period of validity & Revalidated upto
1	11kV, 70kN Polymeric Disc Insulator	<b>13.12.2023</b>
2	9kV, 5kA Metal Oxide Polymeric lightning (Surge) arresters	
3	11kV 5kN Composite Polymeric Pin Insulator	
4	45kN Composite Polymeric Disc Insulator	

### The approval is subject to the following conditions:-

1. The prospective consumers who purchase above said material shall stand guarantee for the materials for a period of Five years from the date of commissioning.
2. The vendor shall furnish all the relevant type test reports before supplies are made as per BESCOM Technical specification & its amendment from time to time issued by M/s CPRI/ERDA or any Govt. lab/Testing houses only and Vendor approvals are considered based on type test reports.
3. All the components utilized for manufacturing above products has to be same as that of utilized in the type test sample.
4. GTP and Drawing approvals shall be obtained by the firm before offering for inspections.

5. The above materials shall be manufactured as per approved drawings (Please refer [www.bescom.karnataka.gov.in](http://www.bescom.karnataka.gov.in) for BESCOM approved drawings) and GTP & drawing approvals shall be obtained before suppliers are made.
6. The above materials shall be got inspected by QS&S or the concerned jurisdictional Engineers, BESCOM before they are put into service.
7. BESCOM reserves the right to call for any document/credentials for verification during drawing approvals/inspection of material/equipment by BESCOM authorities to ascertain the manufacturing experience/performance/technical suitability of the material. Further BESCOM reserves the right to withdraw/cancel the vendor approval issued, in case of any violation of the approved drawing and specification at any time, poor quality /defective materials/equipment to BESCOM projects, poor performance, poor after sales service, etc.
8. For renewal of vendor approval proposal shall be submitted one month prior to expiry of validity of vendor approval.

Approved by Director (Technical)

  
(T.S. Chandran)  
General Manager (El.)  
Quality Standards and Safety,  
BESCOM.

Copy to-

1. The Chief General Manager, Operations/CA/Projects, BESCOM, Bangalore
2. All the Chief Engineer (Electy..) O&M Zones, BESCOM.
3. The General Manager (El.) Procurement / DAS, BESCOM.
4. All Superintending Engineers (El.), O&M Circle, BESCOM.
5. All Executive Engineers (Ele.) O&M Divisions, BESCOM.
6. PS to D (T) to place it before Director (Technical), BESCOM
7. M/s Navitas Insulators Private Limited, Plot No:49, Road No.6, 3<sup>rd</sup> Phase, Obadenahalli Industrial Area, Doddaballapur, Bangalore – 562163 Ph No: 9916603345  
Email: [navitasindia@gmail.com](mailto:navitasindia@gmail.com)
8. Office copy/M.F.





# BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED

(Wholly owned by Government of Karnataka Undertaking)

Telephone No. 080-22252128

E-Mail [gmqs.work@gmail.com](mailto:gmqs.work@gmail.com), [gmqs@bescom.co.in](mailto:gmqs@bescom.co.in)

No: BESCOM/GM(Q,S&S)/AE/BC-11/21-22

Encl:

O/o GM(QS&S)

Corporate Office, K.R. Circle

Bangalore-560 001

Date: 21/03/2022

## OFFICIAL MEMORANDUM FOR VENDOR APPROVAL

Sub : Vendor approval for supply of Ceramic Insulators by M/s Navitas Insulators Private Limited, Bangalore.

Ref : 1. Firm letter No: NIPL/BESCOM/2021-22/VR-001 dtd:09.02.2022.  
2. Approved by Director (Technical), BESCOM vide para (27)/3108 dated:24.03.2022 of T.O note no: GM (QS&S)/DGM-3/BC-11/20-21/100 dated: 19.04.2021

\*\*\*\*\*

Approval is hereby accorded to the below mention firm as approved vendor to BESCOM for supply of the following material to prospective consumers in BESCOM area for Electrification of layouts, M.S. Buildings, Action plan works, Self-execution works, Turnkey works & Partial Turnkey works etc.

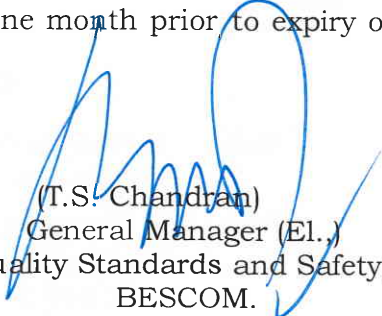
Sl. No	Name of the Firm/ Address/Contact details	Equipment/Materials	Period of validity upto
1	M/s Navitas Insulators Private Limited, Plot No:49, Road No.6, 3 <sup>rd</sup> Phase, Obadenahalli Industrial Area, Doddaballapur, Bangalore – 562163 Ph No: 9916603345 Email: navitasindia@gmail.com	1.1kV Pin Insulator	<b>27.01.2027</b> (Subject to first revalidation dated before <b>30.03.2023</b> and then it will be revalidated once in 2 years)
2		No.8 Strain Insulator	
3		No.15 Strain Insulator	
4		11kV Solid Core Insulator	

### The approval is subject to the following conditions:-

1. The prospective consumers who purchase above said material shall stand guarantee for the materials for a period of Five years from the date of commissioning.
2. The vendor shall furnish all the relevant type test reports before supplies are made as per BESCOM Technical specification & its amendment from time to time issued by M/s CPRI/ERDA or any Govt. lab/Testing houses only and Vendor approvals are considered based on type test reports.
3. All the components utilized for manufacturing above products has to be same as that of utilized in the type test sample.
4. GTP and Drawing approvals shall be obtained by the firm before offering for inspections.
5. The above materials shall be manufactured as per approved drawings (Please refer [www.bescom.karnataka.gov.in](http://www.bescom.karnataka.gov.in) for BESCOM approved drawings) and GTP & drawing approvals shall be obtained before suppliers are made.
6. The above materials shall be got inspected by QS&S or the concerned jurisdictional Engineers, BESCOM before they are put into service.

7. BESCO reserves the right to call for any document/credentials for verification during drawing approvals/inspection of material/equipment by BESCO authorities to ascertain the manufacturing experience/performance/technical suitability of the material. Further BESCO reserves the right to withdraw/cancel the vendor approval issued, in case of any violation of the approved drawing and specification at any time, poor quality /defective materials/equipment to BESCO projects, poor performance, poor after sales service, etc.
8. For renewal of vendor approval proposal shall be submitted one month prior to expiry of validity of vendor approval.

Approved by Director (Technical)

  
(T.S. Chandran)  
General Manager (El.)  
Quality Standards and Safety,  
BESCO.

Copy to-

1. The Chief General Manager, Operations/CA/Projects, BESCO, Bangalore
2. All the Chief Engineer (Electy.,) O&M Zones, BESCO.
3. The General Manager (El.) Procurement / DAS, BESCO.
4. All Superintending Engineers (El.), O&M Circle, BESCO.
5. All Executive Engineers (Ele.) O&M Divisions, BESCO.
6. PS to D (T) to place it before Director (Technical), BESCO
7. M/s Navitas Insulators Private Limited, Plot No:49, Road No.6, 3<sup>rd</sup> Phase, Obadenahalli Industrial Area, Doddaballapur, Bangalore – 562163 Ph No: 9916603345  
Email: navitasindia@gmail.com
8. Office copy/M.F.



**BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED**  
(Wholly owned by Government of Karnataka Undertaking)

Telephone No. 080-22252128

E-Mail gmqs.work@gmail.com, gmqs@bescom.co.in

No: BESCOM/GM(Q,S&S)/AE/BC-11/21-22/cys-185

Encl:

O/o GM(QS&S)

Corporate Office, K.R. Circle

Bangalore-560 001

Date: 31/03/2022

**OFFICIAL MEMORANDUM FOR VENDOR APPROVAL**

Sub :	Renewal of Vendor approval for supply of LT/HT Line Hardware Materials, Lightning Arrester, GOS & Insulator by M/s Power Polymer Industry, Bangalore.
Ref :	1. Firms letter No: PPI/BESCOM/CYS-54/2020-21/002 dated: 03.09.2021. 2. Approved by Director (Technical), BESCOM vide para(11)/3183 dated: 30.03.2022 of T.O note no: GM (QS&S)/DGM-3/BC-11/21-22/2687 dated: 29.03.2022.

\*\*\*\*\*

Approval is hereby accorded to the below mention firm as approved vendor to BESCOM for supply of the material to prospective consumers in BESCOM area for Electrification of layouts, M.S. Buildings, Action plan works, Self-execution works, Turnkey works & Partial Turnkey works etc.

Sl. No	Name of the Firm/ Address/Contact details	Equipment/Materials	Period of validity upto
1	M/s Power polymer Industry, #131/4, Vajrahalli Mantapa Panchayat, Bannerghatta, Jigani Road, Bangalore - 560083 Email: powerpolymers11@gmail.com	<b>Hardware material</b>	<b>31.09.2022</b>
2		11kV Horizontal Cross arms	
3		4 Pin & 2 pin cross arm	
4		11kV Special 3 Pin Cross arm	
5		SPMT Materials for erection of transformer on 25/63kVA on 9mtr RCC/PSCC pole	
6		Guy set (Insulator & GI wire has to be purchased by BESCOM approved Vendors)	
7		G I Grounding Pipe B-class, 42mm Dia, 2.5mtrs long, 3.2mm thick with bolts & nuts, GI strip & washers complete	
8		LT & HT Single Top support	
9		PG clamps	
10		1.1kV & 11kV GI pin	
11		HG Fuse Unit	
12		Clamps for PSCC/RCC poles	
13		Spiral earth electrode	
14		<b>9kV 5kA Lightning arresters</b>	
15		<b>GOS</b>	
16		11kV 200A Single Break GOS	
17		11kV 200A Single Break polymeric post insulator GOS	
18		11kV 400A Double Break polymeric post insulator GOS	
19		<b>Insulator</b>	
20		1.1kV pin Insulator	
21		No. 8kN Strain Insulator	
22		11kV 5kN Polymeric Post insulator	
23		11kV 45/70kN Polymeric Disc Insulator	

**The approval is subject to the following conditions:-**

1. The prospective consumers who purchase above said material shall stand guarantee for the materials for a period of Five years from the date of commissioning.
2. The vendor shall furnish all the relevant valid type test reports as per IS/IEC/BESCOM Technical specification & its amendment from time to time of not older than 5 years issued by M/s CPRI/ERDA or any Govt. lab/Testing houses only and Vendor approvals are considered based on type test reports.
3. All the components utilized for manufacturing above products has to be same as that of utilized in the type test sample.
4. The firm shall supply the materials only after conducting and submission of all the balance type tests as per IS/IEC/BESCOM specification and submitted before 31.09.2022 for further needful.
5. The above materials shall be manufactured as per approved drawings (Please refer [www.bescom.karnataka.gov.in](http://www.bescom.karnataka.gov.in) for BESCOM approved drawings) and GTP & drawing approvals shall be obtained before suppliers are made.
6. GTP and Drawing approvals shall be obtained by the firm before offering for inspections.
7. The above materials shall be got inspected by QS&S or the concerned jurisdictional Engineer BESCOM before they are put into service.
8. BESCOM reserves the right to call for any document/credentials for verification during drawing approvals/inspection of material/equipment by BESCOM authorities to ascertain the manufacturing experience/performance/technical suitability of the material. Further BESCOM reserves the right to withdraw/cancel the vendor approval issued, in case of any violation of the approved drawing and specification at any time, poor quality /defective materials/equipment to BESCOM projects, poor performance, poor after sales service, etc.
9. For renewal of vendor approval proposal shall be submitted one month prior to expiry of validity of vendor approval.

Approved by Director (Technical)

  
(T. S. Chandran)  
General Manager (El.),  
Quality Standards and Safety,  
BESCOM.

**Copy to-**

1. The Chief General Manager, Operations/CA/Projects, BESCOM, Bangalore
2. All the Chief Engineer (Electy.) O&M Zones, BESCOM.
3. The General Manager (El.) Procurement / DAS, BESCOM.
4. All Superintending Engineers (El.), O&M Circle, BESCOM.
5. All Executive Engineers (Ele.) O&M Divisions, BESCOM.
6. PS to D (T) to place it before Director (Technical), BESCOM.
7. M/s Power polymer Industry, #131/4, Vajrahalli Mantapa Panchayat, Bannerghatta, Jigani Road, Bangalore - 560083 (Email:powerpolymers11@gmail.com).
8. Office copy / M.F.



**BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED**  
(Wholly owned by Government of Karnataka Undertaking)

Telephone No. 080-22252128

E-Mail: gmqs.work@gmail.com, gmqs@bescom.co.in

No: BESCOM/GM(Q,S&S)/AE/BC-11/21-22/2724/C 75-186

Encl:

O/o GM (QS&S)

Corporate Office, K.R. Circle

Bangalore-560 001

Date: 31 MAR 2022

**OFFICIAL MEMORANDUM FOR VENDOR APPROVAL**

Sub :	Renewal of Vendor approval for supply of LT/HT Line Hardware Materials & Structural Materials by M/s Zaheer Electricals Industries, Ramangara.
Ref :	1. Firms letter No: NIL dated: 30.03.2022. 2. Approved by Director (Technical), BESCOM vide para (11)/3215 dated: 31.03.2022 of T.O note no: BESCOM/GM (QS&S)/AE/BC-11/21-22/2724 dated: 31.03.2022.

\*\*\*\*\*

Approval is hereby accorded to the below mention firm as approved vendor to BESCOM for supply of the material to prospective consumers in BESCOM area for Electrification of layouts, M.S. Buildings, Action plan works, Self-execution works, Turnkey works & Partial Turnkey works etc.

Sl. No	Name of the Firm/ Address/Contact details	Equipment/Materials	Period of validity upto
1	M/s Zaheer Electrical Industries, No.333/159/57, Shiksha Nagar, 3 <sup>rd</sup> phase, Banikuppe Village, Bidadi Hobli, Ramanagar Ph No: 080-48657679/9902004114 E-mail: zaheerele_ind@yahoo.co.in	11kV DP set	31.03.2024
2		LT/HT Single top support	
3		11kV Horizontal cross arm	
4		2 Pin & 4 Pin cross Arm	
5		11kV Special 3 Pin Cross Arms	
6		Spiral Earth Electrode	
7		Guy set (Insulator & GI wire has to be purchased by BESCOM approved Vendors)	
8		G I Grounding Pipe B-class, 42mm Dia, 2.5mtrs long, 3.2mm thick with bolts & nuts, GI strip & washers complete	
9		PG Clamps	
10		Clamps for PSCC/RCC poles	
11		H- frame set for fixing GOS	
12		LT spacers for DTC wiring	
13		Aerial Fuse Board	
14		SPMT Materials for erection of transformer on 25/63kVA on 9mtr RCC/PSCC pole	
15		11kV 200Amps Single Break GOS	

**Approval is subject to the following conditions:-**

1. The prospective consumers who purchase above said material shall stand guarantee for the materials for a period of Five years from the date of commissioning.
2. The vendor shall furnish all the relevant valid type test reports (as per BESCOM Technical specification & its amendment from time to time) issued by M/s CPRI/ERDA or any Govt. lab/Testing houses only and Vendor approvals are considered based on type test reports.



3. All the components utilized for manufacturing above products has to be same as that of utilized in the type test sample.
4. GTP and Drawing approvals shall be obtained by the firm before offering for inspections.
5. The above materials shall be manufactured as per approved drawings (Please refer [www.bescom.karnataka.gov.in](http://www.bescom.karnataka.gov.in) for BESCOM approved drawings) and GTP & drawing approvals shall be obtained before suppliers are made.
6. The above materials shall be got inspected by QS&S or the concerned jurisdictional Engineers, BESCOM before they are put into service.
7. BESCOM reserves the right to call for any document/credentials for verification during drawing approvals/inspection of material/equipment by BESCOM authorities to ascertain the manufacturing experience/performance/technical suitability of the material. Further BESCOM reserves the right to withdraw/cancel the vendor approval issued, in case of any violation of the approved drawing and specification at any time, poor quality /defective materials/equipment to BESCOM projects, poor performance, poor after sales service, etc.
8. For renewal of vendor approval proposal shall be submitted one month prior to expiry of validity of vendor approval.

Approved by Director (Technical)

  
(T.S. Chandran)  
General Manager (El.)  
Quality Standards and Safety,  
BESCOM.

Copy to-

1. The Chief General Manager, Operations/CA/Projects, BESCOM, Bangalore.
2. All the Chief Engineer(Electy.), O&M Zones, BESCOM.
3. The General Manager (El.) Procurement / DAS, BESCOM.
4. All Superintending Engineers (El.), O&M Circle, BESCOM.
5. All Executive Engineers (Ele.) O&M Divisions, BESCOM.
6. PS to D (T) to place it before Director (Technical), BESCOM.
7. M/s Zaheer Electrical Industries, No.333/159/57, Shiksha Nagar, 3rd phase, Banikuppe Village, Bidadi Hobli, Ramanagar Ph No: 080-48657679/9902004114, E-mail: zaheerele\_ind@yahoo.co.in
8. Office copy / M.F.



**BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED**  
(Wholly owned by Government of Karnataka Undertaking)

Telephone No. 080-22252128

O/o GM (QS&S)

E-Mail: gmqs.work@gmail.com, gmqs@bescom.co.in

Corporate Office, K.R. Circle

No: BESCOM/GM(Q,S&S)/AE/BC-11/21-22/CYS-187

Bangalore-560 001

Encl:

Date: **31 MAR 2022**

**OFFICIAL MEMORANDUM FOR VENDOR APPROVAL**

Sub :	Vendor approval for supply of LT/HT Line Hardware Materials & Structural Materials by M/s M.B. Industries, Bangalore.
Ref :	1. Firms letter No: NIL dated: 30.03.2022. 2. Approved by Director (Technical), BESCOM vide para (9)/3216 dated: 31.03.2022 of T.O note no: BESCOM/GM (QS&S)/AE/BC-11/21-22/2725 dated: 31.03.2022.

\*\*\*\*\*

Approval is hereby accorded to the below mention firm as approved vendor to BESCOM for supply of the material to prospective consumers in BESCOM area for Electrification of layouts, M.S. Buildings, Action plan works, Self-execution works, Turnkey works & Partial Turnkey works etc.

Sl. No	Name of the Firm/ Address/Contact details	Equipment/Materials	Period of validity upto
1	M/s M.B. Industries, No.18/1, Arekempanahalli, 2nd A cross, Wilson Garden, Bangalore - 560027 Ph No: 080-48657679, 9902004114 E-mail: industries_mb@yahoo.co.in	11kV Horizontal cross arm	<b>31.03.2023</b>
2		2 Pin & 4 Pin cross Arm	
3		11kV Special 3 Pin Cross Arms	
4		Clamps for PSCC/RCC poles	
5		PG Clamps	
6		LT spacers for DTC wiring	
7		G I Grounding Pipe B-class, 42mm Dia, 2.5mtrs long, 3.2mm thick with bolts & nuts, GI strip & washers complete	
8		H- frame set for fixing GOS	
9		Copper Lugs and Terminals	
10		11kV DP set	
11		LT Brass Terminal Connector for Transformer (630 Amps, Approx. Weight 0.790kg)	
12		11kV 200Amps Single Break GOS	
13		11kV 400Amps Double Break GOS	
14		11kV DOLO Cutout	
15		HG Fuse Unit	
16		Three phase LT AB cable distribution box for 5 & 6 connection and Single phase LT AB cable distribution box for 20 & 10 connections	
17		Insulating piercing connectors.	
18		Eye Hook	
19		Dead End Clamp	
20		Suspension clamp assembly	

**Approval is subject to the following conditions:-**

1. The prospective consumers who purchase above said material shall stand guarantee for the materials for a period of Five years from the date of commissioning.
2. The vendor shall furnish all the relevant valid type test reports (as per BESCO Technical specification & its amendment from time to time) issued by M/s CPRI/ERDA or any Govt. lab/Testing houses only and Vendor approvals are considered based on type test reports.
3. All the components utilized for manufacturing above products has to be same as that of utilized in the type test sample.
4. GTP and Drawing approvals shall be obtained by the firm before offering for inspections.
5. The above materials shall be manufactured as per approved drawings (Please refer [www.bescom.karnataka.gov.in](http://www.bescom.karnataka.gov.in) for BESCO approved drawings) and GTP & drawing approvals shall be obtained before suppliers are made.
6. The above materials shall be got inspected by QS&S or the concerned jurisdictional Engineers, BESCO before they are put into service.
7. BESCO reserves the right to call for any document/credentials for verification during drawing approvals/inspection of material/equipment by BESCO authorities to ascertain the manufacturing experience/performance/technical suitability of the material. Further BESCO reserves the right to withdraw/cancel the vendor approval issued, in case of any violation of the approved drawing and specification at any time, poor quality /defective materials/equipment to BESCO projects, poor performance, poor after sales service, etc.
8. For renewal of vendor approval proposal shall be submitted one month prior to expiry of validity of vendor approval.

Approved by Director (Technical)

  
(T.S. Chandran)  
General Manager (El.)  
Quality Standards and Safety,  
BESCO.

Copy to-

1. The Chief General Manager, Operations/CA/Projects, BESCO, Bangalore.
2. All the Chief Engineer(Electy.), O&M Zones, BESCO.
3. The General Manager (El.) Procurement / DAS, BESCO.
4. All Superintending Engineers (El.), O&M Circle, BESCO.
5. All Executive Engineers (Ele.) O&M Divisions, BESCO.
6. PS to D (T) to place it before Director (Technical), BESCO.
7. M/s M.B. Industries, No.18/1, Arekempnahalli, 2<sup>nd</sup> A cross, Wilson Garden, Bangalore - 560027  
Ph No: 080-48657679, 9902004114 E-mail: industries\_mb@yahoo.co.in
8. Office copy / M.F.